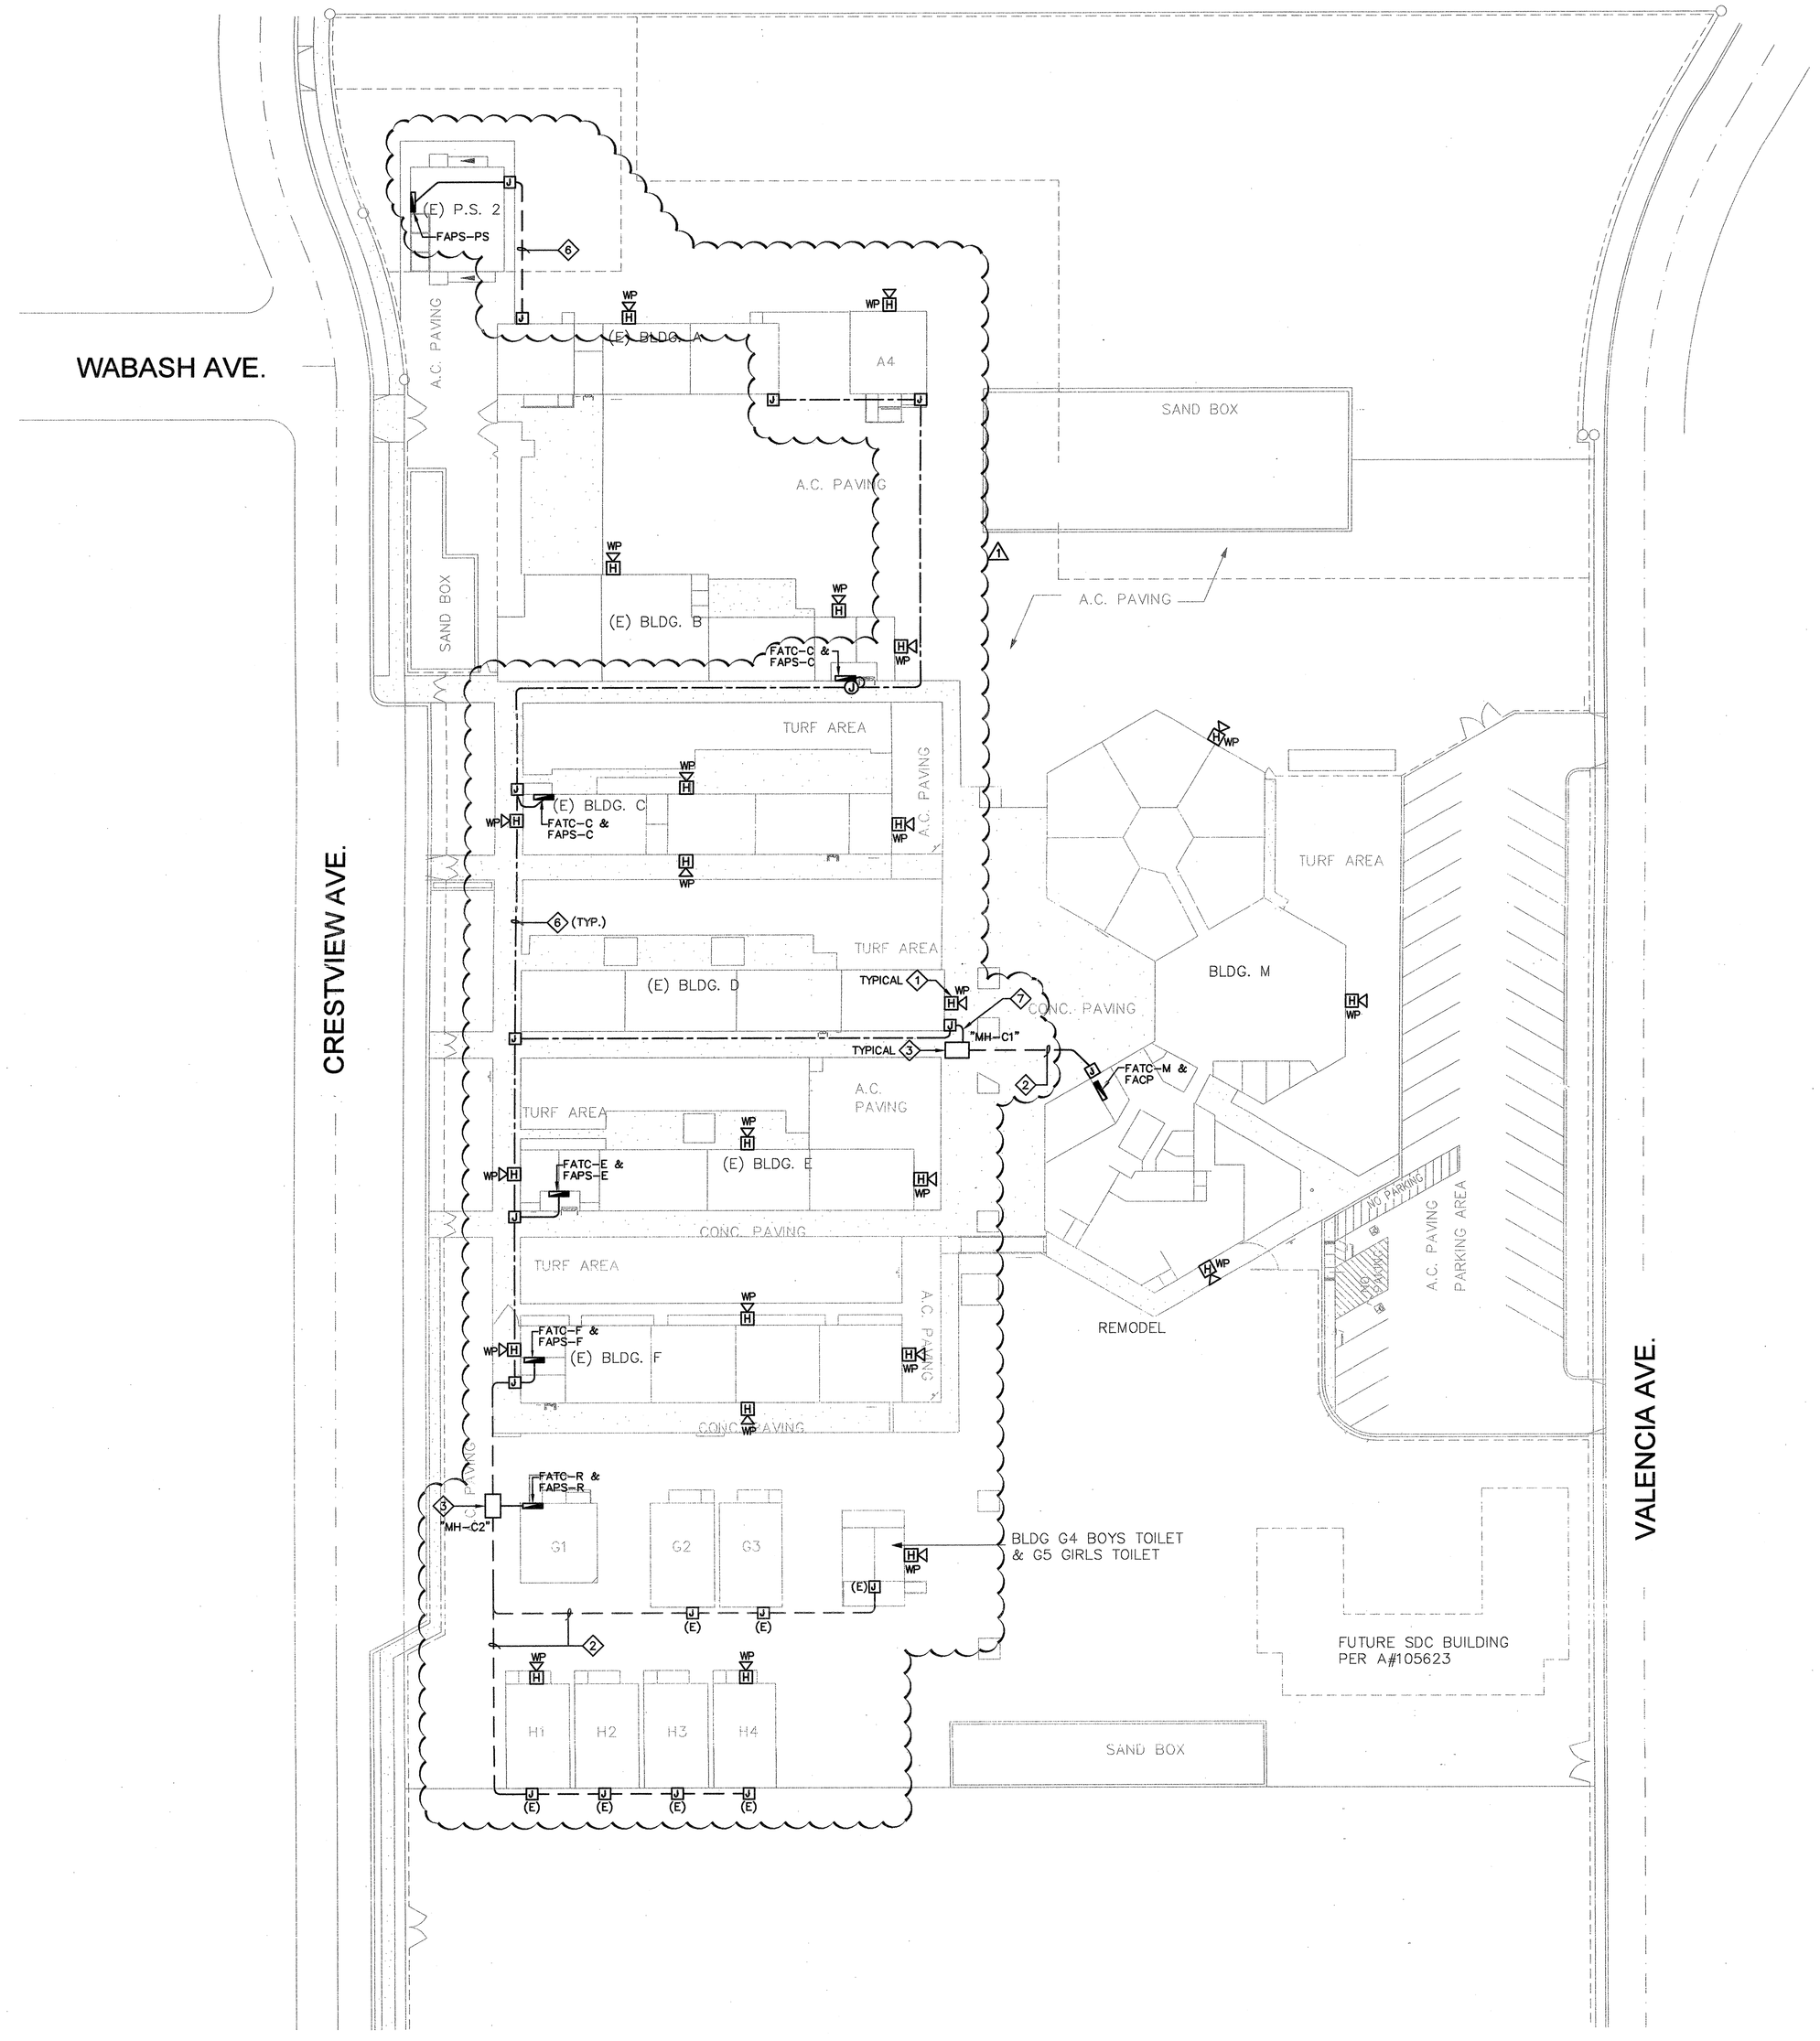

HMC GROUP
3270 INLAND EMPIRE BLVD.
ONTARIO, CALIFORNIA 91764
Telephone: 909·989·9979
Fax: 909·483·1400
Architecture • Interiors • Planning

SHEET NOTES

1. EXTERIOR HORNS SHOWN ON THIS SHEET FOR REFERENCE ONLY. SEE BUILDING FIRE ALARM PLANS FOR EXACT QUANTITIES AND LOCATIONS OF ALL DEVICES, TYPICAL.
2. SAWCUT, TRENCH AND EXCAVATE EXISTING SURFACE AS REQUIRED TO INSTALL NEW CONDUITS. BACKFILL, TAMP PER SPECIFICATIONS AND RESURFACE TO MATCH EXISTING CONDITIONS.
3. PROVIDE AND INSTALL 18" x 24" x DEPTH REQUIRED PRECAST PULLBOX WITH BOLT DOWN METAL TRAFFIC RATED COVER. SET ON 6" COMPACTED CRUSHED ROCK.
4. CONDUIT ROUTING ARE SHOWN DIAGRAMMATICALLY. CONTRACTOR SHALL INVESTIGATE AND VERIFY ROUTING TO MINIMIZE CROSSING EXISTING UTILITIES WHILE MAINTAINING SHORTEST CONDUIT RUNS. COORDINATE ROUTING OF ALL UNDERGROUND CONDUITS WITH ELECTRICAL SITE PLAN AND OTHER UTILITIES. COMMON TRENCH SHALL BE USED FOR ALL UNDERGROUND UTILITIES. COORDINATE WITH ARCHITECTURAL, CIVIL AND PLUMBING DRAWINGS, TYPICAL.
5. REFER TO FIRE ALARM RISER DIAGRAM FOR CONDUIT SIZES, REFER TO PLAN DRAWINGS FOR ADDITIONAL CONDUIT RUNS, TYPICAL.
6. MOUNT CONDUIT ON EXTERIOR WALL OR ON TOP OF WALKWAY CANOPY. SEE DETAIL #2, SHEET E-4.1 FOR MOUNTING DETAIL.
7. RISE UP ON EXTERIOR WALL.

KEY PLAN

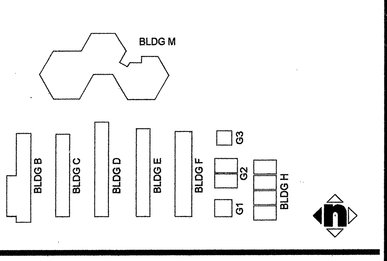

AGENCY APPROVAL

FILE NO.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
APPL. 04-107962
AC ____ FLS ____ SS ____
DATE ____

CONSTRUCTION DOCUMENT

SAN BERNARDINO CITY UNIFIED SCHOOL DISTRICT
777 NORTH "F" STREET
SAN BERNARDINO, CA. 92410

© HMC GROUP 2000

No	Revisions/Submissions	Date
1	ADDENDUM #1	7/31/08
3	ADD. NO. 3	2/23/10

Consultant Seal

Consultant: DOLLMORE & ASSOCIATES, INC. Electrical Engineers

Project Title
BRADLEY ELEMENTARY SCHOOL
MODERNIZATION
SAN BERNARDINO, CA

Drawing Title
FIRE ALARM SITE PLAN

Architect's Seal

Designed: BM	Project No: 3137106
Drawn: CV	Scale: AS NOTED
Checked: JJR	Drawing No: AD1-E03
Reviewed: JJR	E-1.1
Date: 10-27-06	

FIRE ALARM SITE PLAN | A17

1" = 30'-0"

P:\SBCUSD-Mods\Bradley #20-03147\Dwgs\E\20-03147E11.dwg 7-18-08-11:22 AM

DCGA # 20-03147

" BID ISSUANCE SET"