


DWG: Q:\Collins\IETMC\500 CAD\FP\Sheet\FP-202.dwg User: teejr
DATE: Oct 25, 2008 - 10:56:33 am Images:
Xrefs: "XBD" "IETMC-AP02" "IETMC-SGRD" "IETMC-FP02" "IETMC-S-BLDG-Independent_nt-1-xAP02"

E
D
C
B
A

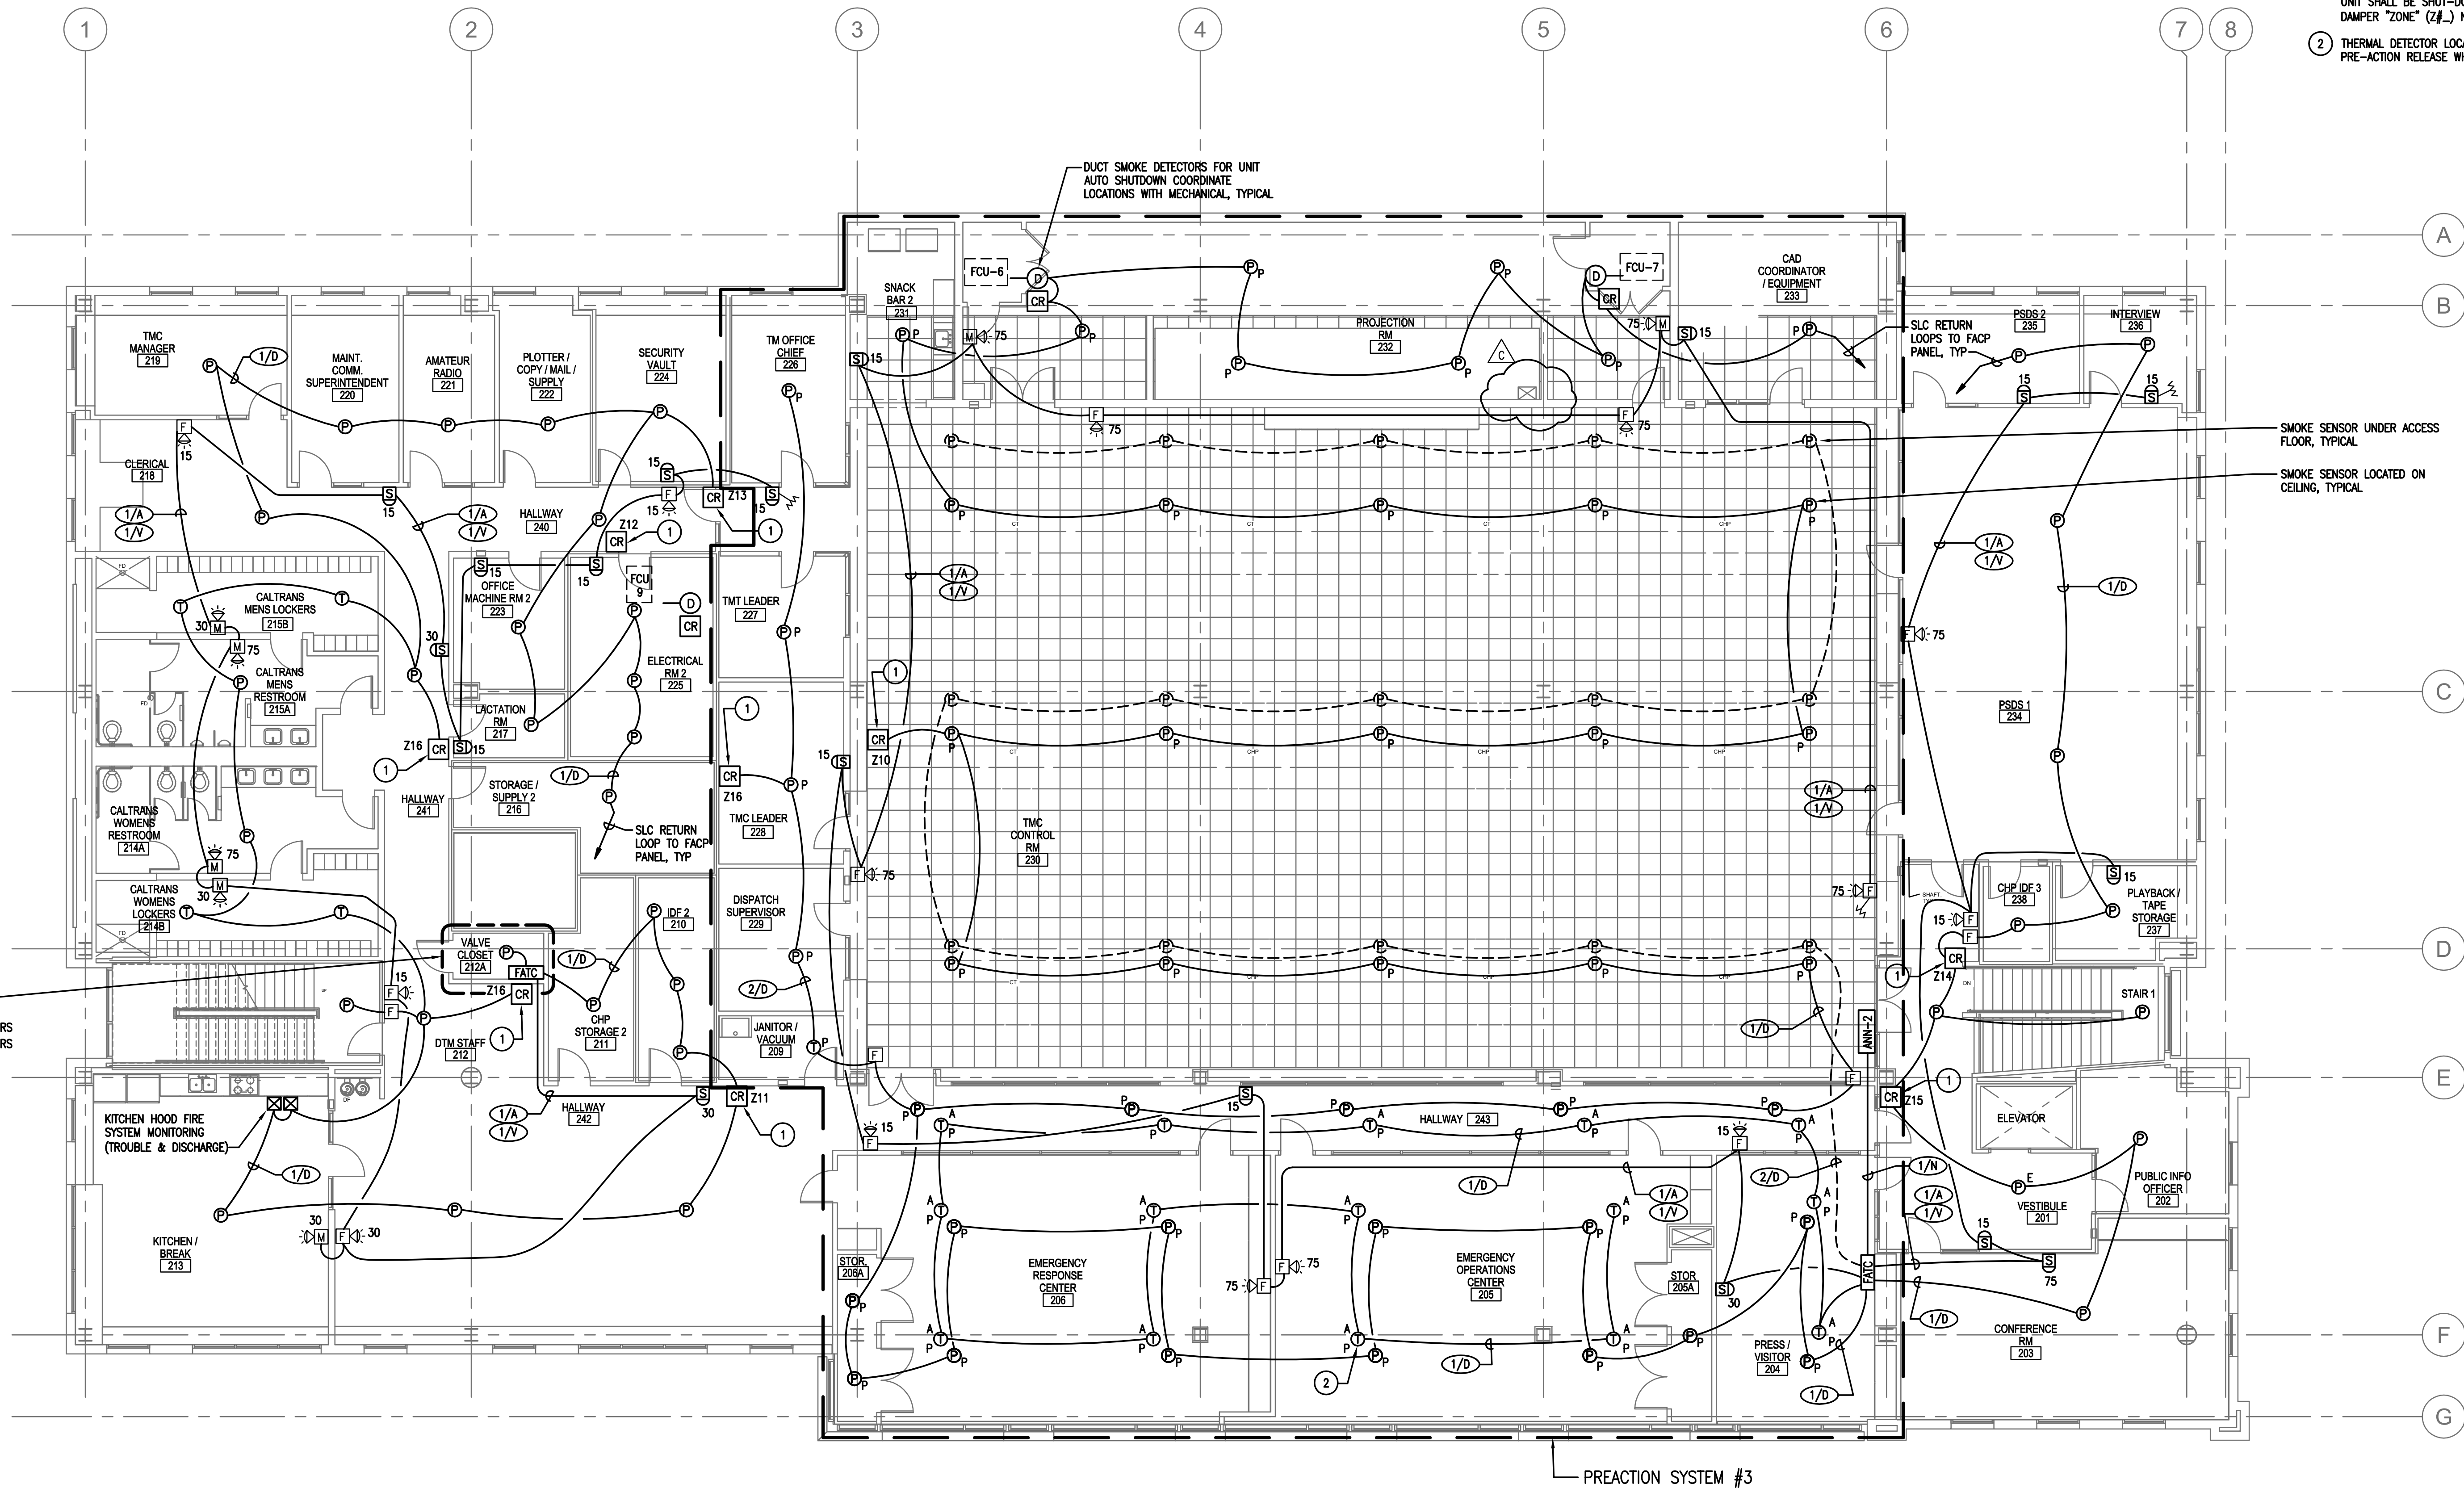

- NOTES:
- SEE DRAWING FP-101 FOR FIRE SPRINKLER NOTES, LEGEND DETAILS AND ABBREVIATIONS.
 - SEE SHEET FP-102 FOR FIRE ALARM SYSTEM NOTES, LEGEND, OPERATION MATRIX AND RISER DIAGRAM.
 - FOR ROOM NAMES AND FIRE RATED WALL LOCATIONS SEE ARCHITECTURAL DRAWINGS.
 - FOR ANNUNCIATOR DETAILS, SEE SHEET FP-702.

- CALL OUT NOTES:
- PROVIDE ADDRESSABLE CONTROL RELAY MODULES FOR FIRE/SMOKE DAMPER CONTROL BY ZONE (SEE RISER DIAGRAM NOTES FOR DAMPER CONTROL ZONES). REFER TO MECHANICAL PLANS FOR EXACT QUANTITY AND LOCATIONS OF DAMPERS. MAXIMUM OF 8 FIRE/SMOKE DAMPERS (FS/SD) SHALL BE CONTROLLED PER MODULE. ASSOCIATED HVAC UNIT SHALL BE SHUT-DOWN WITH ZONE WHERE APPLICABLE. DAMPER "ZONE" (Z#...) NUMBER INDICATED.
 - THERMAL DETECTOR LOCATED ABOVE CEILING - USED FOR PRE-ACTION RELEASE WHERE APPLICABLE.

PROJECT



CLIENT



STATE OF CALIFORNIA
DEPARTMENT OF GENERAL SERVICES
REAL ESTATE SERVICES DIVISION
PROJECT MANAGEMENT BRANCH
400 R STREET, SUITE 5100
SACRAMENTO, CA 95814
PROJECT DIRECTOR : RAJAT ALARAJI
TELEPHONE : (916) 376-1738

DESIGNER

DMJM H&N | AECOM

999 TOWN & COUNTRY ROAD, ORANGE, CALIFORNIA 92668
T: 714-567-2400 F: 714-543-0955 www.dmjmh.com

CONSULTANT

DSA STAMP

IDENTIFICATION STAMP
DIVISION OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICE

APPL. #: 04-109200-2

AC _____ FLS _____ SS _____
DATE _____

FILE NUMBER: RESD

STATUS

JULY 30, 2008


ISSUE

MARK	DATE	DESCRIPTION
1	10/27/2008	BID PERIOD ADDENDUM#5

PROJECT NO: 60004333.4000

DRAWN BY: L. DICKENS
CHECKED BY: D. WIRTZ

STAMP

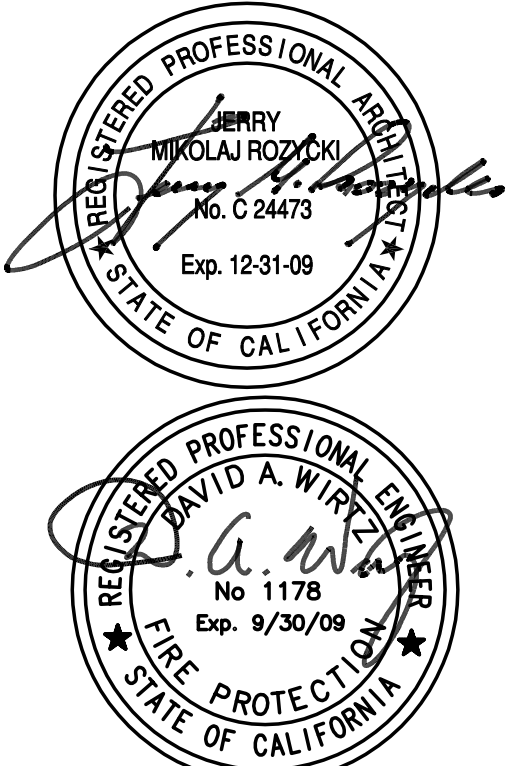

SHEET TITLE


FIRE ALARM PLAN
SECOND FLOOR

FP-202

1 FIRE ALARM PLAN- SECOND FLOOR

FP-202 REF. SCALE: 1/8" = 1'-0"

DESIGNATION	WIRE/CABLE	CIRCUIT TYPE
R	2#12 THHN/XHHW	RELEASING
A	2#12 THHN/XHHW	AUDIBLE
V	2#12 THHN/XHHW	VISUAL
D	2#16 WEST PENN D975 (SLC)	INDOOR DATA LOOP
DU	4#16 WEST PENN AQ 3245	OUTDOOR DATA LOOP
N	#16 RS-485	ANNUNCIATOR

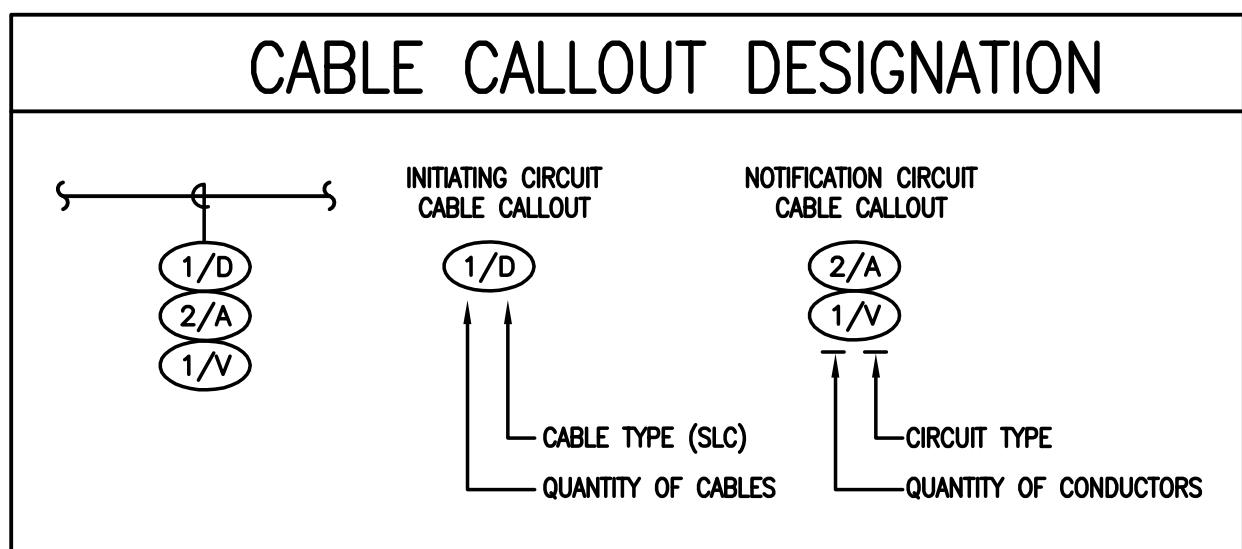

FIRE PROTECTION DRAWINGS ARE FOR PERFORMANCE/SCOPE ONLY.
CONTRACTOR IS REQUIRED TO SUBMIT SYSTEM SHOP DRAWINGS TO
AOR/EOR FOR REVIEW AND APPROVAL.

GRAPHIC SCALE:

1/8"=1' 0 4 8 16 24

