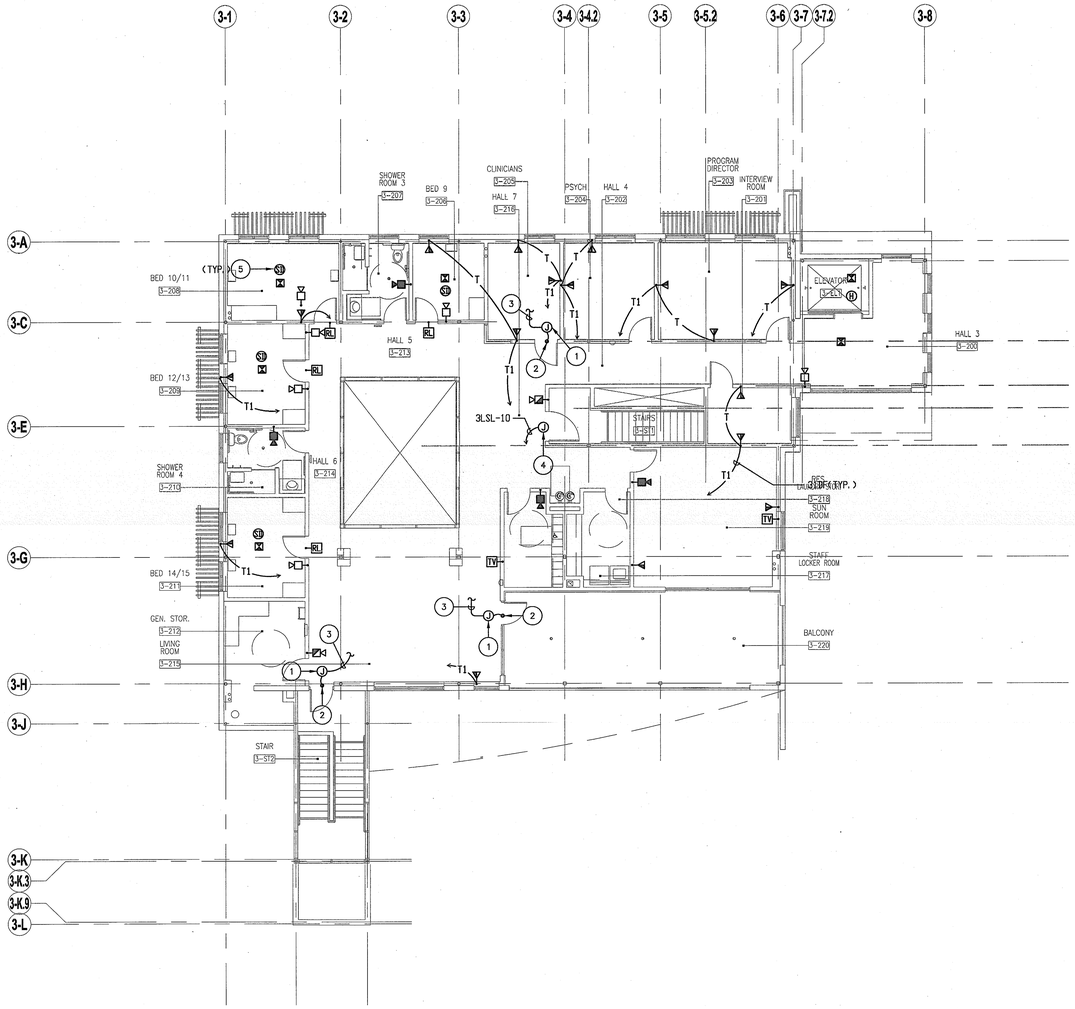

KEYNOTES

1. PROVIDE ROUGH-IN J-BOX ABOVE DOOR/CEILING WITH 3/4"C. FOR DOOR POSITION SWITCH (DPS).
2. CONNECT 3/4" CONDUIT TO ABOVE DOOR FRAME.
3. ROUTE 3/4" CONDUIT TO RECEPTION DESK. COORDINATE EXACT TERMINAL POINT OF CONDUIT IN THE RECEPTION ROOM PRIOR TO ROUGH-IN. PROVIDE APPROPRIATE SIZE OF FULL STRING.
4. MOUNT J-BOX ABOVE CEILING FOR POWER CONNECTION TO SECURITY DOOR HARDWARE. COORDINATE WITH SECURITY SYSTEM PROVIDER/INSTALLER PRIOR TO ROUGH-IN.
5. ACTIVATION OF SMOKE DETECTOR SHALL CAUSE A VISUAL DISPLAY ON LIGHT INDICATOR ABOVE ROOM DOOR IN WHICH THE DETECTOR IS LOCATED AND SHALL CAUSE AN AUDIBLE AND VISUAL ALARM AT THE RECEPTION CLERICAL STATION. A STAND ALONE SYSTEM OF THIS FUNCTION SHALL BE PROVIDED PER CFC 907.2.6.1.

KEYPLAN

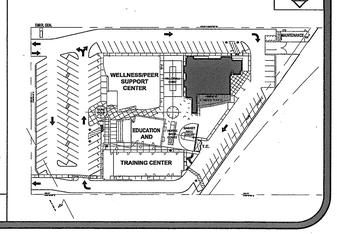

BUILDING 3 - SECOND FLOOR SIGNAL PLAN | SCALE: 1/8"=1'-0" | 1

County of Orange
OC PUBLIC WORKS
Architecture & Engineering

Revisions

Sym.	Descrip.	Date	By

0742

Consultants
FBA ENGINEERING
Fire Protection Engineers
3420 Irvine Avenue, Suite 200
Newport Beach, California 92660-2616
Tel: 949.660.1616 Fax: 949.660.1010
FBAEngr.com
FBA # 446.025

Drawn ___ Chkd. ___ Date 1-26-09

A-E Seal

A-E ALEXANDER + HIBBS, AIA, INC.
ALEXANDER + HIBBS AIA INC.
Architecture and Planning
1000 Quail Street, Suite 200
Newport Beach, California 92660
(949) 756-0595

Design RH Chkd. JP Date Nov. 26, 2009

Sht Title BUILDING 3 - SECOND FLOOR SIGNAL PLAN
Project COUNTY OF ORANGE HEALTH CARE AGENCY
401 SOUTH TUSTIN STREET
401 SOUTH TUSTIN STREET
ORANGE, CA 92866
PROJ. NO. 100-042-P210-4200

Plan No.
52333-03608

Sheet
E-2.3.6

0742 COUNTY OF ORANGE HEALTH CARE AGENCY 401 SOUTH TUSTIN STREET