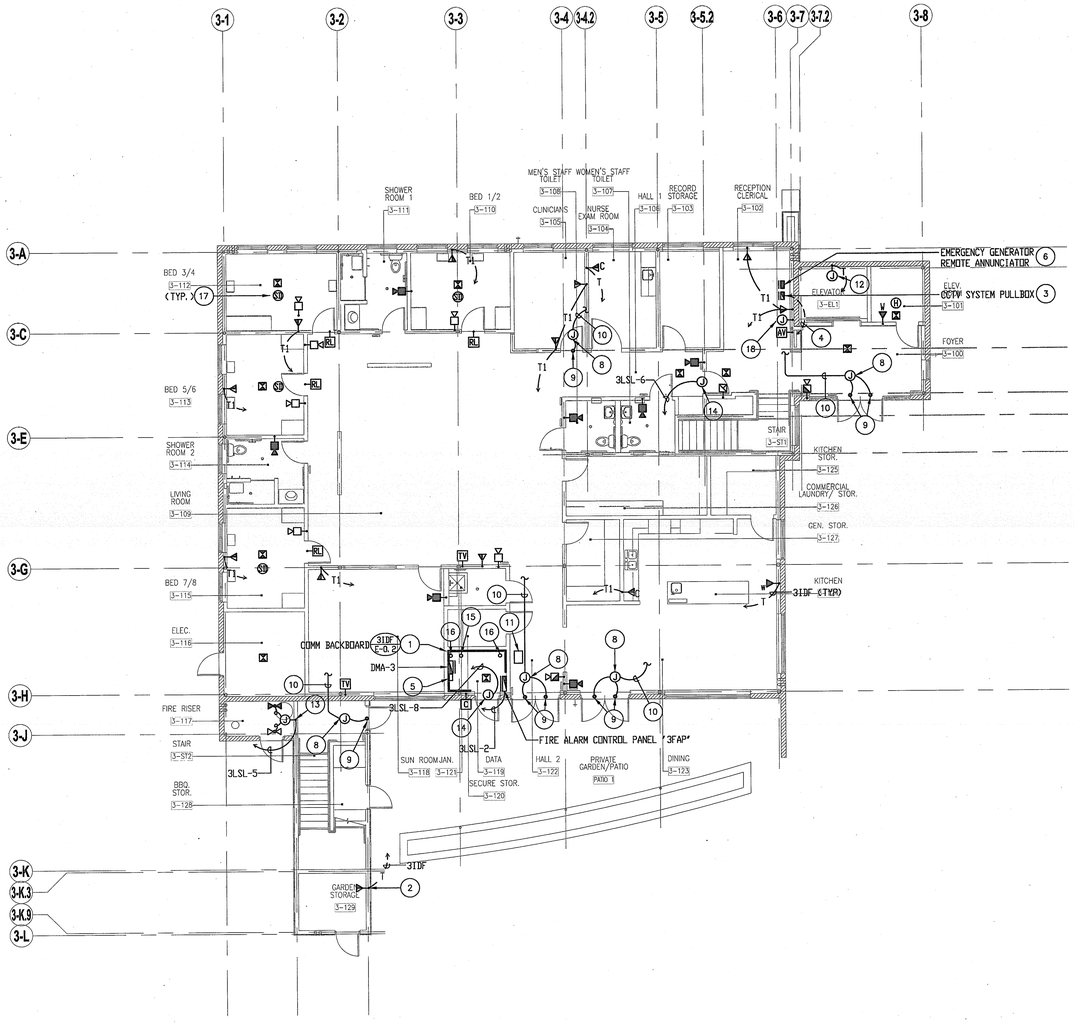

KEYNOTES

1. 3/4" THICK X 8' H. FIRE RETARDANT PLYWOOD BACKBOARD, WIDTH AS SHOWN.
2. FOR IRRIGATION CONTROLLER.
3. CCTV MONITOR/SWITCHER LOCATION AT RECEPTION DESK. PROVIDE 12"SQ X 4"D. FLUSH WALL MOUNTED, +12" ABOVE FLOOR, SCREW COVER NEMA 1 PULLBOX WITH 2" X 2" NOTCHED OPENING IN COVER FOR CABLES. GROMMET OPENING.
4. 2"C. TO 31DF.
5. CCTV POWER SUPPLY.
6. FLUSH WALL MOUNT +36".
7. NOT USED.
8. PROVIDE ROUGH-IN J-BOX ABOVE DOOR/CEILING WITH 3/4"C. FOR DOOR POSITION SWITCH (DPS).
9. CONNECT 3/4" CONDUIT TO ABOVE DOOR FRAME.
10. ROUTE 3/4" CONDUIT TO RECEPTION DESK. COORDINATE EXACT TERMINAL POINT OF CONDUIT IN THE RECEPTION ROOM PRIOR TO ROUGH-IN. PROVIDE APPROPRIATE SIZE OF PULL STRING.
11. PROVIDE PULLBOX ABOVE CEILING LEVEL FOR VOICE/DATA. PULL BOX SHALL BE USED FOR VOICE/DATA CONDUIT HOMERUN POINT. SEE PULLBOX DETAIL #6 ON PLAN SHEET E-2.4.1. COORDINATE WITH ARCHITECT FOR CEILING ACCESS PANELS.
12. J-BOX FOR ELEVATOR CAB TELEPHONE.
13. J-BOX FOR POWER CONNECTION TO FA TAMPER AND FLOW SWITCHES.
14. MOUNT J-BOX ABOVE CEILING FOR POWER CONNECTION TO SECURITY DOOR HARDWARE. COORDINATE WITH SECURITY SYSTEM PROVIDER/INSTALLER PRIOR TO ROUGH-IN.
15. 2-4" CONDUITS FROM MPOE ROOM BLDG. 1. STUB 6' A.F.F.
16. 1-4" CONDUIT WITH 12" SWEEP. COORDINATE WITH TEL/DATA CONTRACTOR PRIOR TO ROUGH-IN.
17. ACTIVATION OF SMOKE DETECTOR SHALL CAUSE A VISUAL DISPLAY ON LIGHT INDICATOR ABOVE ROOM DOOR IN WHICH THE DETECTOR IS LOCATED AND SHALL CAUSE AN AUDIBLE AND VISUAL ALARM AT THE RECEPTION CLERICAL STATION. A STAND ALONE SYSTEM OF THIS FUNCTION SHALL BE PROVIDED PER CFC 907.2.6.1.
18. FOUR GANG J-BOX FOR TERMINAL POINT OF CONDUIT HOMERUNS FOR DOOR POSITIONING SWITCHES. MOUNT J-BOX ABOVE CEILING AND ROUTE (1) 1" CONDUIT FROM J-BOX TO WALL MOUNTED AUDIBLE INDICATOR IN THE RECEPTION. COORDINATE REQUIREMENT WITH SYSTEM PROVIDER/INSTALLER.

KEYPLAN

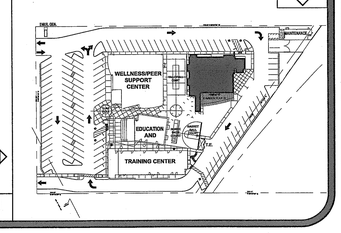

BUILDING 3 - FIRST FLOOR SIGNAL PLAN | SCALE: 1/8"=1'-0" | 1

0742 COUNTY OF ORANGE HEALTH CARE AGENCY 401 SOUTH TUSTIN STREET

Filename: L:\ARCHIVES\E-2.3.5.dwg, Layout: E-2.3.5, Plotted by: Rodney Hall, Nov 26, 2009 - 8:27am
Xrefs: xwd_logo, xbnd, xbnd_ALEX_3, ALEX_3, ALEX_1

County of Orange
OC PUBLIC WORKS
Architecture & Engineering

Revisions: 0742 | Sym. | Descrip. | Date | By

Consultants
FBA ENGINEERING
Fire Protection Systems
3420 Irvine Avenue
Newport Beach, California 92660-2689
Tel: (949) 261-1577 Fax: (949) 261-0922
FBAengr.com
FBA # 446.025
Drawn | Chkd. | Date 11-26-09

A-E Seal

A-E ALEXANDER + HIBBS, AIA, INC.
ALEXANDER + HIBBS, AIA, INC.
Architecture and Planning
1300 N. Jefferson, St. 100
Anaheim, CA 92807
(714) 630-0488
Design RH | Chkd. JP | Date Nov. 26, 2009

Sht Title BUILDING 3 - FIRST FLOOR SIGNAL PLAN
Project COUNTY OF ORANGE HEALTH CARE AGENCY
401 SOUTH TUSTIN STREET
401 SOUTH TUSTIN STREET
ORANGE, CA 92866
PROJ. NO. 100-042-P210-4200

Plan No. 52333-03608

Sheet E-2.3.5