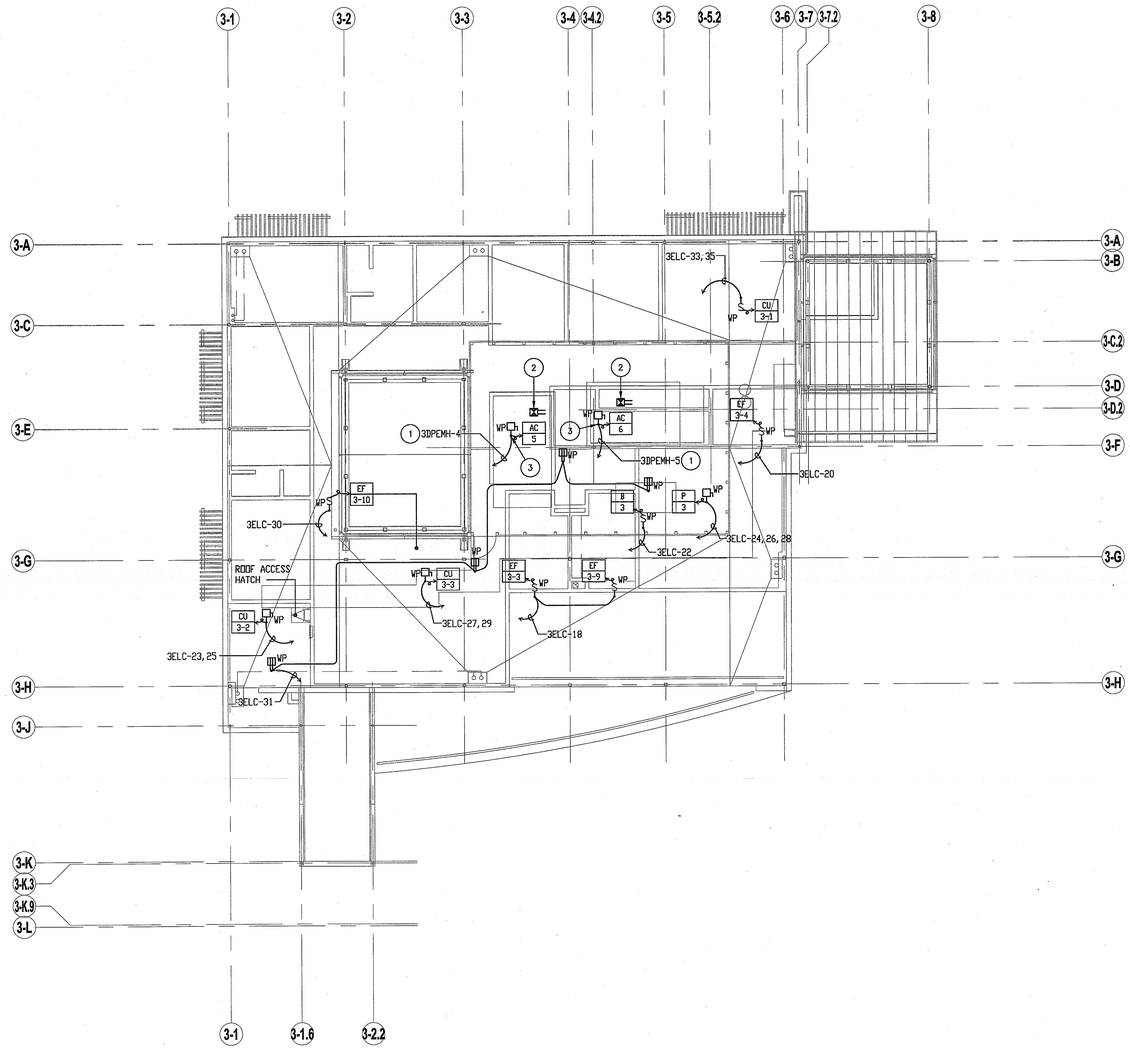

KEYNOTES

1. REFER TO SINGLE LINE DIAGRAM SHEET E-0.1 FOR FEEDER REQUIREMENTS.
2. INTERFACE FIRE ALARM ADDRESSABLE IN-DUCT TYPE SMOKE DETECTOR IN AC SUPPLY/RETURN AIR DUCTS WITH FIRE ALARM SYSTEM IN THE BUILDING. UTILIZING FA ALARM CONTROL MODULE RELAY. FA CONDITION OR UPON DETECTION OF FIRE SMOKE IN SUPPLY AIR DUCTS SHALL CAUSE AC SUPPLY FAN MOTOR TO SHUT DOWN.
3. CONNECT TO AC'S SUPPLY FAN VFD AS REQUIRED. COORDINATE WITH MECHANICAL CONTRACTOR.

KEYPLAN

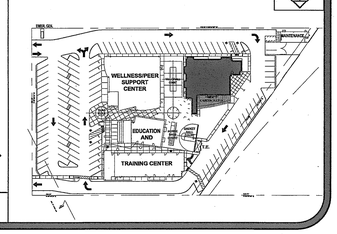

BUILDING 3 - SECOND ROOF PLAN

SCALE: 1/8"=1'-0"

1

County of Orange
OC PUBLIC WORKS
Architecture & Engineering

Sym.	Descrip.	Date	By

Revisions

0742

Consultants

FBA ENGINEERING
Civil Engineers
3420 Bristol Street, Suite 600
Transportation Engineers
Traffic Engineers
Newport Beach, California 92660-3189
Tel: (949) 474-1960 Fax: (949) 852-1687
FBAengr.com

FBA # 446.025

Drawn | Chkd. | Date 1-26-09

A-E Seal

A-E

ALEXANDER + HIBBS, AIA, INC.
ALEXANDER + HIBBS AIA INC
Architecture and Planning
1300 N. Grandview Ave., Suite A
Upland, CA 91786
(909) 920-0888

Design DF | Chkd. AH | Date Nov. 26, 2009

Sht Title BUILDING 3 - SECOND ROOF PLAN

Project COUNTY OF ORANGE HEALTH CARE AGENCY
401 SOUTH TUSTIN STREET

401 SOUTH TUSTIN STREET
ORANGE, CA 92866

PROJ. NO. 100-042-P210-4200

Plan No.
52333-03608

Sheet
E-2.3.7

0742 COUNTY OF ORANGE HEALTH CARE AGENCY 401 SOUTH TUSTIN STREET