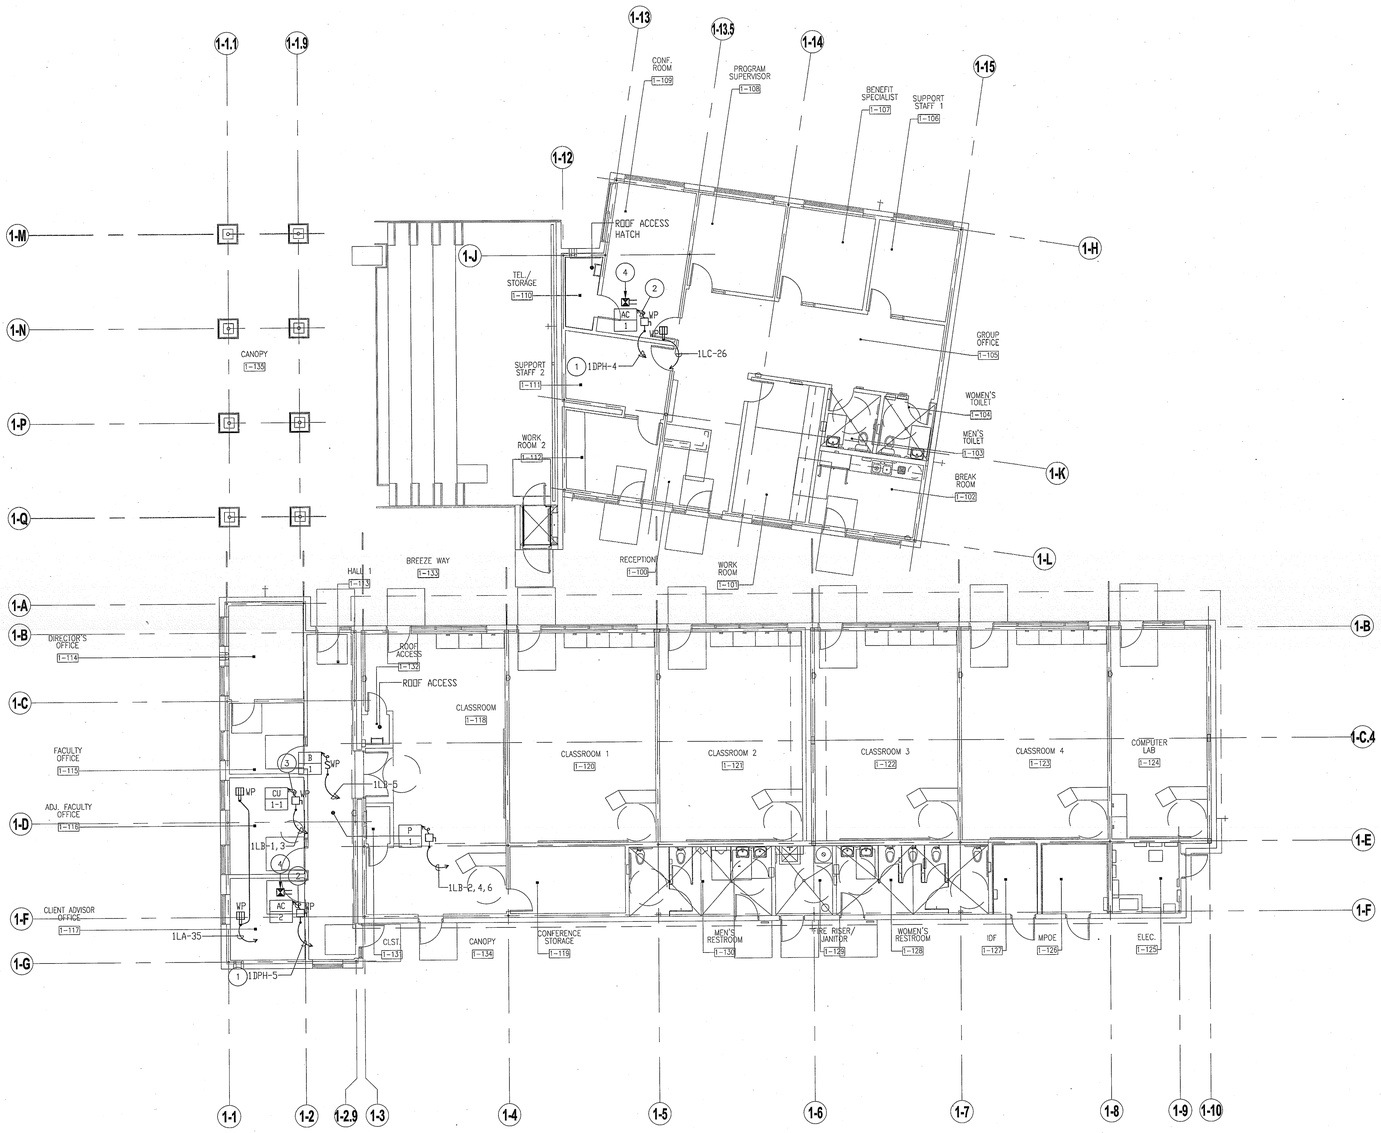

KEYNOTES

1. REFER TO SINGLE LINE DIAGRAM. SHEET EO. 1 FOR FEEDER REQUIREMENTS.
2. CONNECT TO AC'S SUPPLY FAN VFD AS REQUIRED. COORDINATE WITH MECHANICAL CONTRACTOR.
3. WIRING AND CONTROL TO CU SHALL BE PER MANUFACTURER'S RECOMMENDATIONS.
4. INTERFACE FIRE ALARM ADDRESSBLE IN-DUCT TYPE SMOKE DETECTOR WITH FIRE ALARM SYSTEM IN THE BUILDING. COORDINATE WITH MECHANICAL CONTRACTOR.

KEYPLAN

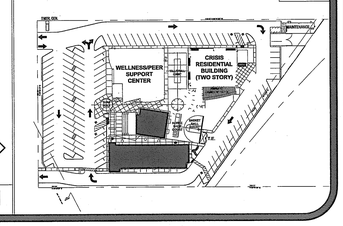

BUILDING 1 - HIGH ROOF PLAN

SCALE: 1/8"=1'-0"

1

County of Orange
OC PUBLIC WORKS
Architecture & Engineering

Revisions

Sym.	Descrip.	Date	By

0742

Consultants

FBA ENGINEERING
Consulting Engineers
1600 Sunflower Ave.
Newport Beach, California 92660-7693
Voice: (949) 642-1181 Fax: (949) 642-1697
FBAEng@aol.com
FBA # 446.025

Drawn ___ Chkd. ___ Date 3/26/09

A-E Seal

A-E ALEXANDER + HIBBS, AIA, INC.

ALEXANDER + HIBBS, AIA, INC.
Architecture and Planning
1000 N. Jefferson St., Suite A
Anaheim, CA 92807
(714) 630-3366

Date Nov. 26, 2009
Chkd. AH
Design DF

Sht Title BUILDING 1-HIGH ROOF PLAN

Project COUNTY OF ORANGE HEALTH CARE AGENCY
401 SOUTH TUSTIN STREET
401 SOUTH TUSTIN STREET
ORANGE, CA 92866

PROJ. NO. 100-042-P210-4200

Plan No.
52333-03608

Sheet
E-2.1.4

0742 COUNTY OF ORANGE HEALTH CARE AGENCY 401 SOUTH TUSTIN STREET

Filename: 1-HIGHROOF.E-2.1.4.DWG
Layout: E-2.1.4 Scale: 1:1 Plotted: 3/26/09 2:03 PM
Xrefs: 0742 E0.1, HVL Hatches 0742 E0