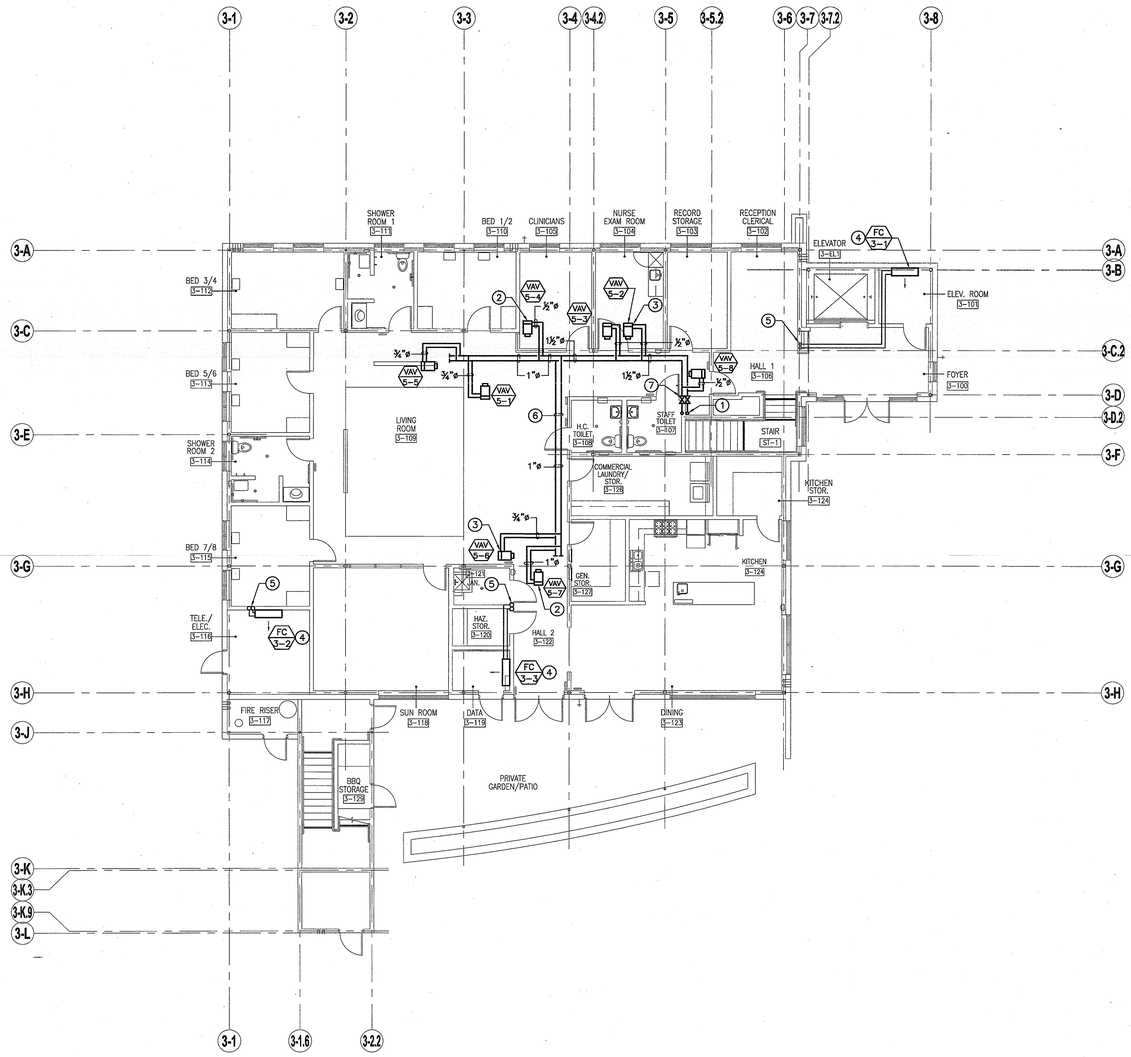

KEYNOTES

1. 1½"ø INSULATED HEATING HOT WATER SUPPLY AND RETURN PIPING UP. SEE DWG M-2.3.4 FOR CONTINUATION. SEE PIPING DIAGRAM 1/M-3.2.
2. VAV BOX ABOVE CEILING (TYP.). SEE DETAIL 2/M-3.1.
3. CONNECT HWS AND HWR BRANCH PIPING TO REHEAT COIL IN VAV BOX. SEE DETAIL 3/M-3.1
4. FAN COIL UNIT ON WALL, INSTALL AS HIGH AS PRACTICAL. SEE DETAIL 4/M-3.2
5. ⅜" REFRIGERANT LIQUID AND INSULATED ⅝" SUCTION PIPING TO CONDENSING UNIT ON ROOF.
6. SEE PIPE SUPPORT DETAIL 6/M-3.2 (TYP.)
7. LINE SIZE SHUT-OFF VALVE WITH CEILING ACCESS PANEL.

KEY PLAN

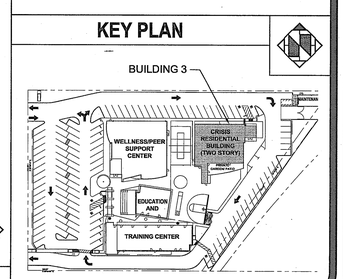

BUILDING 3 - MECHANICAL FIRST FLOOR PIPING PLAN

SCALE: 1/8"=1'-0"

1

County of Orange

OC PUBLIC WORKS

Architecture & Engineering

Revisions

Sym.	Descrip.	Date	By

0742

Consultants

FTA ARCHITECTS

Drawn Chkd. Date 11-26-09

A-E Seal

A-E ALEXANDER + HIBBS, AIA, INC.

ALEXANDER + HIBBS, AIA, INC.
Architecture and Planning
2030 E. Chapman Ave. #
Orange, California 92867
(714) 639-9000

Design Chkd. Date Nov. 26, 2009

Sht Title BLDG 3 - MECHANICAL FIRST FLOOR PIPING PLAN

Project COUNTY OF ORANGE HEALTH CARE AGENCY
401 SOUTH TUSTIN STREET
401 SOUTH TUSTIN STREET
ORANGE, CA 92866

PROJ. NO. 100-042-P210-4200

Plan No. 52333-03608

Sheet M-2.3.3

0742 COUNTY OF ORANGE HEALTH CARE AGENCY 401 SOUTH TUSTIN STREET