KEY NOTES

1. ~~REPLACE AND ADJUST MOUNTING HEIGHT OF NON-ADA COMPLIANT DUPLEX RECEPTACLE AND JUNCTION BOX. EXTEND EXISTING CONDUIT TO THE NEW MOUNTING HEIGHT OF DUPLEX RECEPTACLE. MOUNTING HEIGHT OF NEW DUPLEX RECEPTACLE SHALL BE +16" AFF MINIMUM TO BOTTOM LINE OF DUPLEX RECEPTACLE.~~ NIC
2. PROVIDE SURFACE DEVICE BOX AND DEVICE INDICATED. EXTEND DUAL CHANNEL METALLIC SURFACE RACEWAY. ROUTE TO ABOVE CEILING, INSTALL QUANTITY OF CABLES AS INDICATED AND ROUTE CABLES UNSPLICED. REFER TO DETAIL2, SHEET E7.0
3. REPLACE EXISTING STANDARD DUPLEX RECEPTACLE WITH NEW GFI TYPE, +6" ABOVE COUNTER.
4. REPLACE EXISTING DUPLEX RECEPTACLE WITH NEW.
5. PROVIDE/INSTALL DUPLEX RECEPTACLE FOR PROJECTOR MOUNTED ON CEILING. VERIFY EXACT LOCATION OF PROJECTOR IN THE FIELD.
6. RECEPTACLE MOUNTED ON "IDF" BACK WALL.
7. PANELBOARD MOUNTING DATAIL, REFER TO DETAIL 4, SHEET E7.1.
8. 1-HOUR FIRE RATED WALL, REFER TO DETAIL 2, SHEET E7.1.

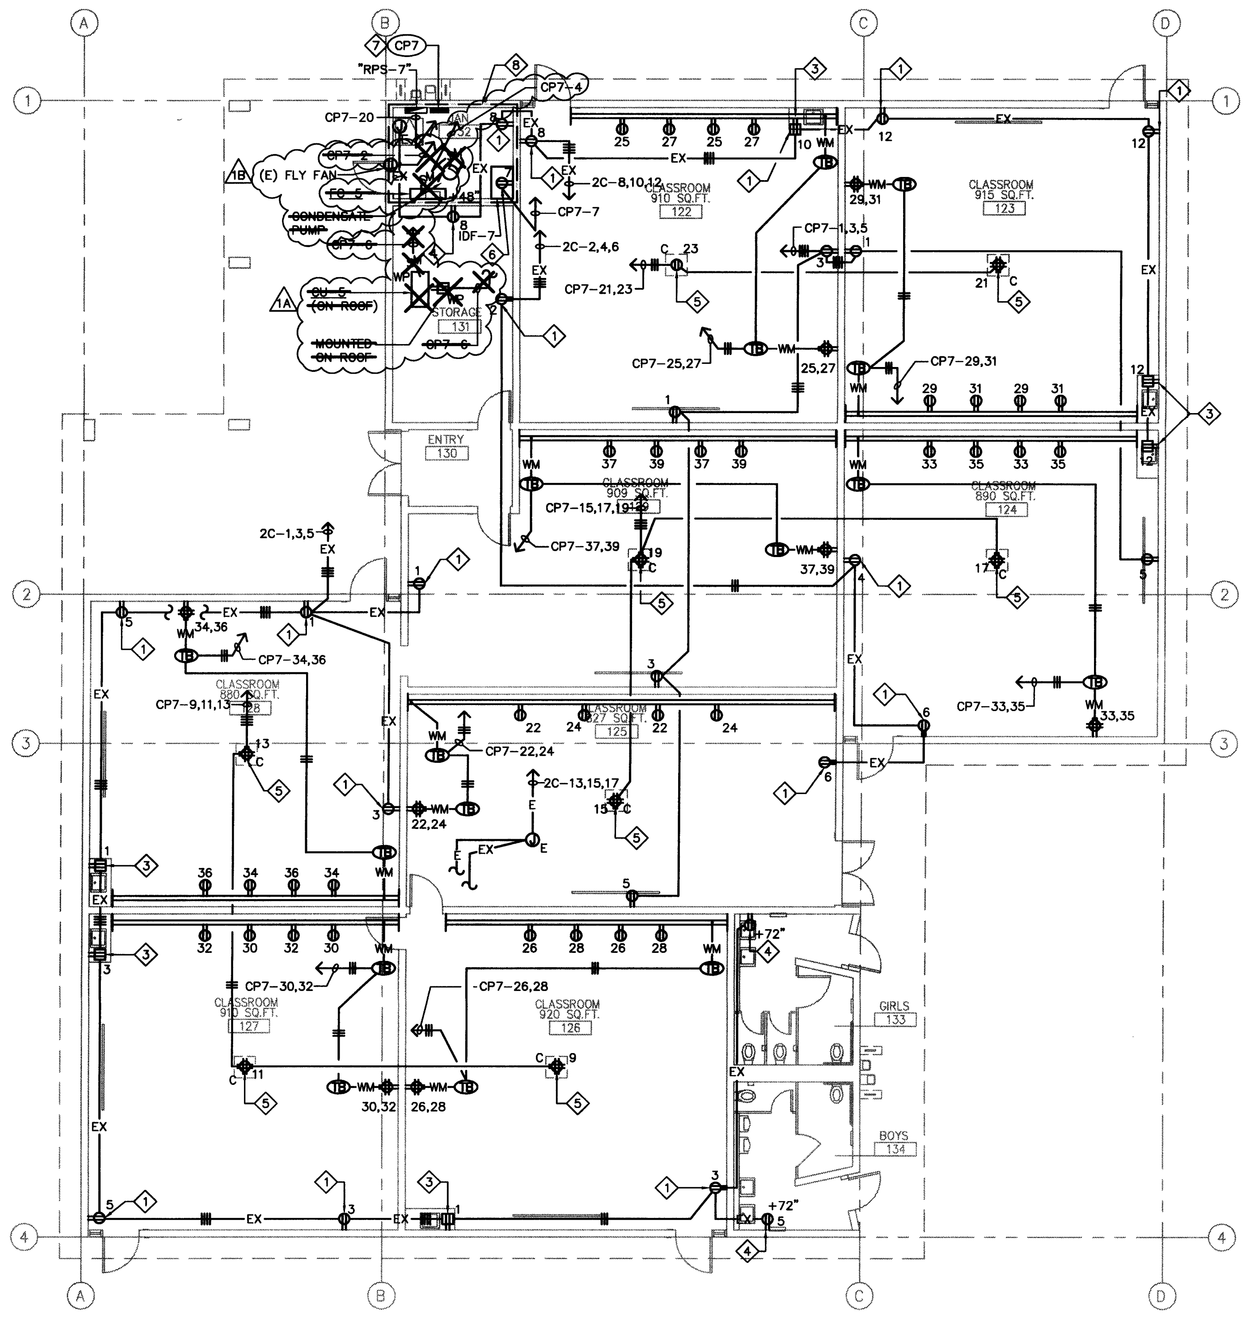

BUILDING 7 - POWER PLAN 1/8"=1'-0" 2

KEY NOTES

1. ~~REPLACE AND ADJUST MOUNTING HEIGHT OF NON-ADA COMPLIANT DUPLEX RECEPTACLE AND JUNCTION BOX. EXTEND EXISTING CONDUIT TO THE NEW MOUNTING HEIGHT OF DUPLEX RECEPTACLE. MOUNTING HEIGHT OF NEW DUPLEX RECEPTACLE SHALL BE +16" AFF MINIMUM TO BOTTOM LINE OF DUPLEX RECEPTACLE.~~ NIC
2. PROVIDE SURFACE DEVICE BOX AND DEVICE INDICATED. EXTEND DUAL CHANNEL METALLIC SURFACE RACEWAY. ROUTE TO ABOVE CEILING, INSTALL QUANTITY OF CABLES AS INDICATED AND ROUTE CABLES UNSPLICED. REFER TO DETAIL2, SHEET E7.0
3. REPLACE EXISTING STANDARD DUPLEX RECEPTACLE WITH NEW GFI TYPE, +6" ABOVE COUNTER.
4. REPLACE EXISTING DUPLEX RECEPTACLE WITH NEW.
5. PROVIDE/INSTALL DUPLEX RECEPTACLE FOR PROJECTOR MOUNTED ON CEILING. VERIFY EXACT LOCATION OF PROJECTOR IN THE FIELD.
6. RECEPTACLE MOUNTED ON "IDF" BACK WALL.
7. PANELBOARD MOUNTING DATAIL, REFER TO DETAIL 4, SHEET E7.1.
8. 1-HOUR FIRE RATED WALL, REFER TO DETAIL 2, SHEET E7.1.

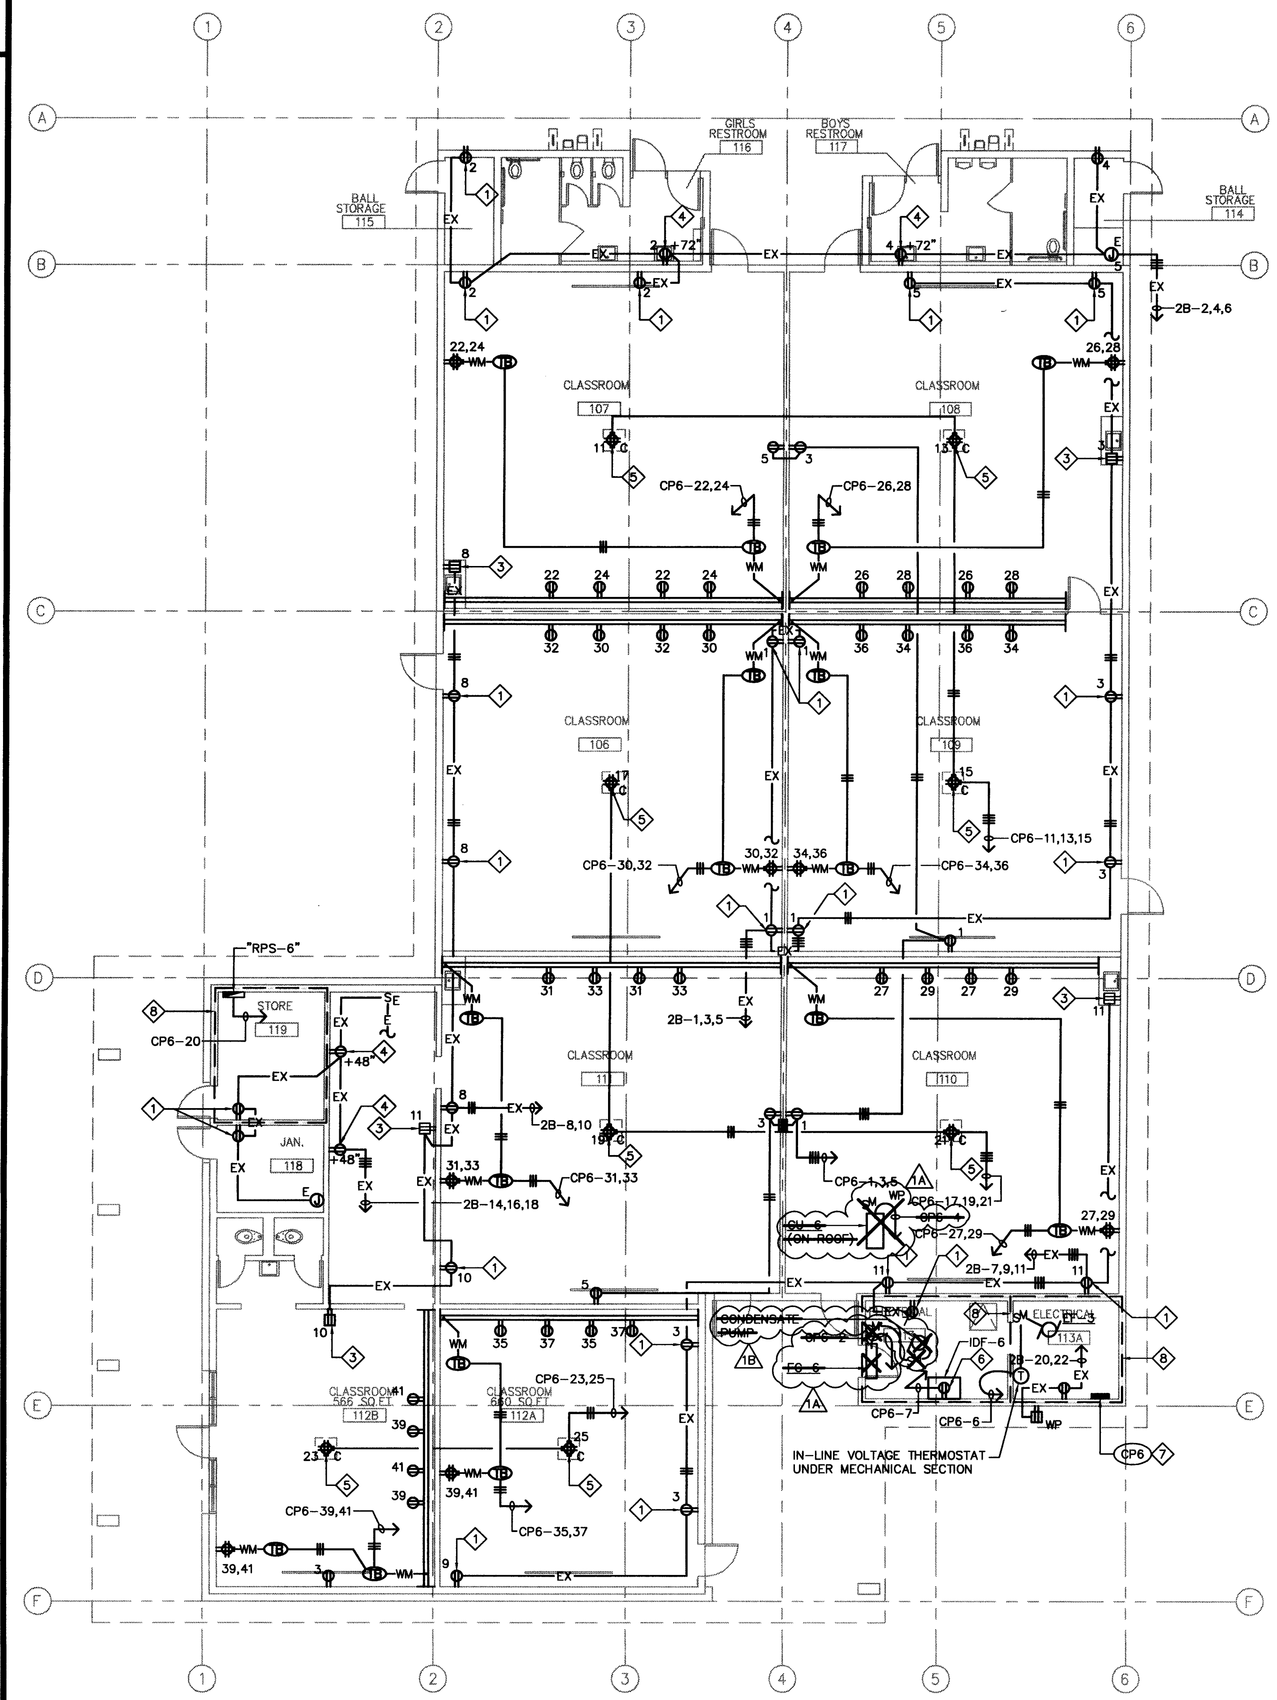

BUILDING 6 - POWER PLAN 1/8"=1'-0" 1

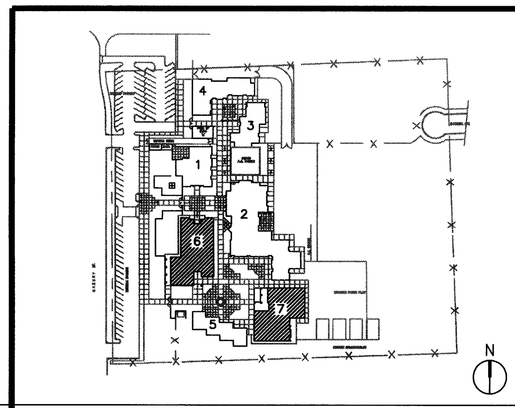

KEY PLAN

gkkworks
2355 Main Street Suite 220
Irvine | CA 92614
949 250 1500
949 955 2708 fax

Architect Seal

LICENSED ARCHITECT GUILLERMO AGUILAR NO. C13165 REN.: MAY. 2013 STATE OF CALIFORNIA

Consultant and Seal

TTG
• STRUCTURAL • MECHANICAL • ELECTRICAL • CIVIL
TMAD TAYLOR & GAINES
901 Via Piemonte, Suite 400
Ontario, California 91764
Phone: 909.477.6915 Fax: 909.477.6916
www.ttgcorp.com Project No. 2008.125.00

REGISTERED PROFESSIONAL ENGINEER HESTON C. TAYLOR III Lic. E16934 Exp. 6-30-2013 ELECTRICAL STATE OF CALIFORNIA

Agency Approval

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APPL. 04-110031
AC _____ FLS _____ SS _____
DATE _____

No.	Date	Revision/Issue
	12/08/08	DSA SUBMITTAL
	02/11/09	DSA SUBMITTAL
	5/11/09	DSA BACKCHECK
1A	12/16/2011	ADDENDUM 1A
1B	01/20/2012	ADDENDUM 1

Project Name

MUIR
FUNDAMENTAL
SCHOOL MODERNIZATION
1951 MABURY ST.
SANTA ANA, CA 92707

Checked By	Drawn By
RA	JH/JHC

Sheet Title

BUILDINGS 6 & 7
POWER PLANS

Sheet Number

E3.4

Project Number	Scale
10021-010	AS NOTED

©2012 gkkworks, All Rights Reserved
NO PART OF THE CONTENTS OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN PERMISSION OF GKKWORKS.

N:\20.CAD\TTG_Projects\2008\2008-125-00\Mpe\E3-4.dwg 01/19/2012