KEY NOTES

1. REMOVE EXISTING RPS AND PROVIDE NEW RPS, NOTIFIER FCPS-24S8. DISCONNECT EXISTING FIRE ALARM CIRCUITS FROM EXISTING RPS, RECONNECT CIRCUITS TO REMAIN TO NEW RPS
2. 1-HOUR FIRE RATED WALL, REFER TO DETAIL 2/E7.1.

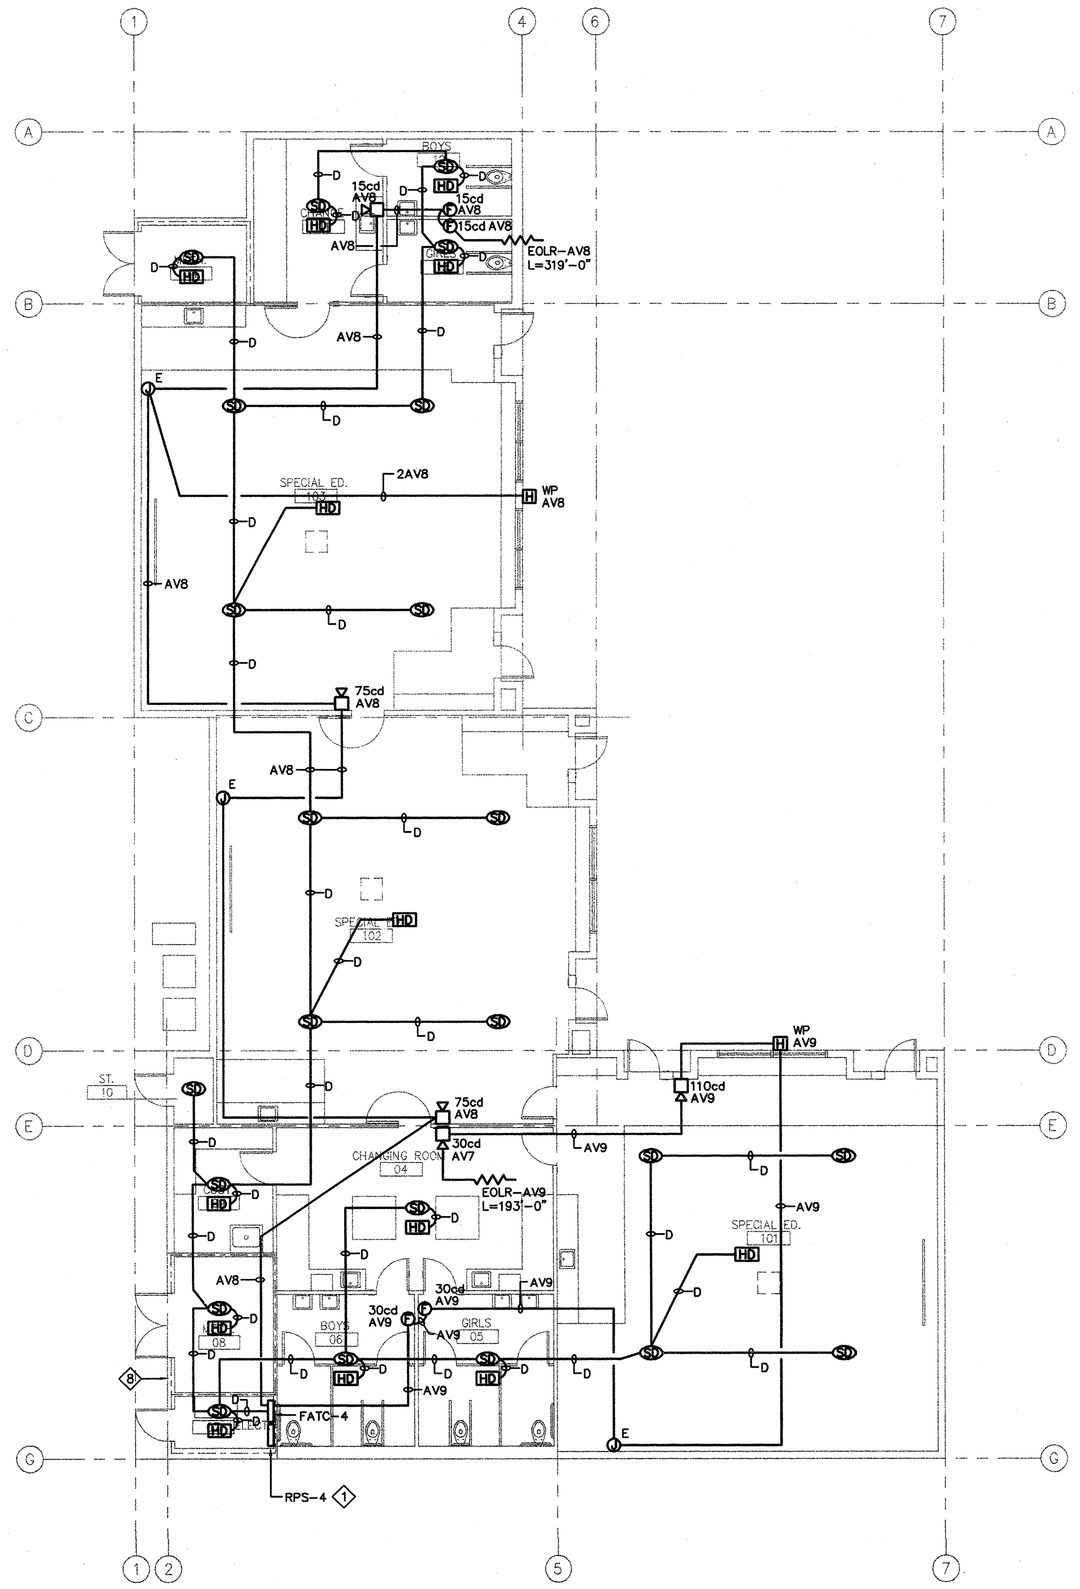

BUILDING 4 - FIRE ALARM PLAN

1/8"=1'-0" | 2

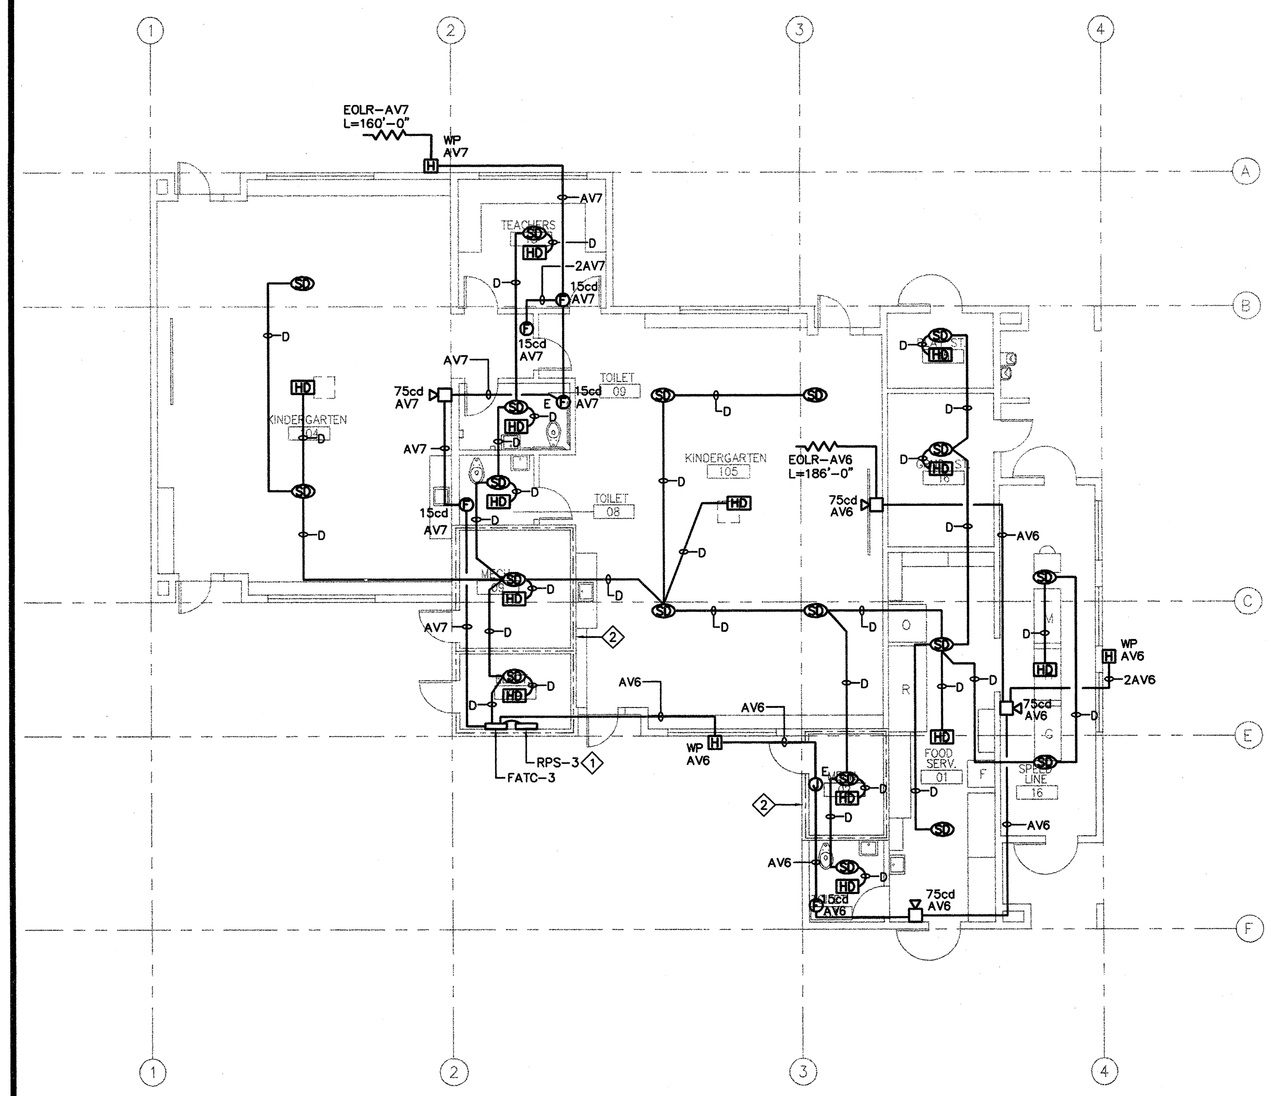

BUILDING 3 - FIRE ALARM PLAN

1/8"=1'-0" | 1

KEY NOTES

Provide District Standard

1. REMOVE EXISTING RPS AND PROVIDE NEW RPS, NOTIFIER FCPS-24S8. DISCONNECT EXISTING FIRE ALARM CIRCUITS FROM EXISTING RPS, RECONNECT CIRCUITS TO REMAIN TO NEW RPS
2. 1-HOUR FIRE RATED WALL, REFER TO DETAIL 2/E7.1.

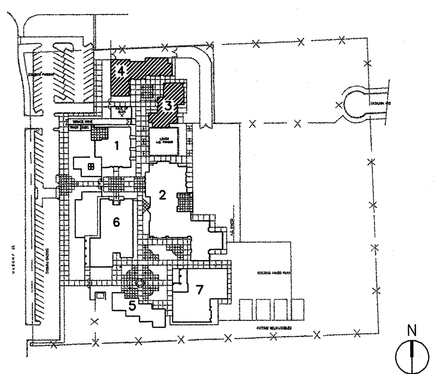

KEY PLAN

SANTA ANA UNIFIED SCHOOL DISTRICT

gkkworks
2355 Main Street Suite 220
Irvine | CA 92614
949 250 1500
949 955 2708 fax

Architect Seal

LICENSED ARCHITECT GUILLERMO AGUILAR NO. C13165 REN.: MAY. 2011 STATE OF CALIFORNIA

Consultant and Seal

TMAD TAYLOR & GAINES
- STRUCTURAL
- MECHANICAL
- ELECTRICAL
- CIVIL

800 North Ferrari Lane, Suite 100
Ontario, California 91764
Phone: 909.477.6915 Fax: 909.477.6916
Project No. 2008.125.00

REGISTERED PROFESSIONAL ENGINEER HECTOR C. TOGUCHI Lic. E16934 Exp. 6-30-2011 ELECTRICAL STATE OF CALIFORNIA

Agency Approval

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APPL. 04-110031
AC FLS SS
DATE NOV 24 2009

No.	Date	Revision/Issue
	12/08/08	DSA SUBMITTAL
	02/11/09	DSA SUBMITTAL
	5/11/09	DSA BACKCHECK
	12/15/2011	BID SET

Project Name

MUIR FUNDAMENTAL SCHOOL MODERNIZATION
1951 MABURY ST.
SANTA ANA, CA 92707

Checked By	Drawn By
RA	KA

Sheet Title

BUILDINGS 3 & 4 FIRE ALARM PLANS

Sheet Number

E5.3

Project Number	Scale
10021-010	AS NOTED

© 2009 gkkworks, All Rights Reserved
NO PART OF THE CONTENTS OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE WRITTEN PERMISSION OF GKKWORKS.

N:\20.CAD\TTG_Projects\2008\2008-125-00\Mpe\E5-3.dwg 11/09/2009