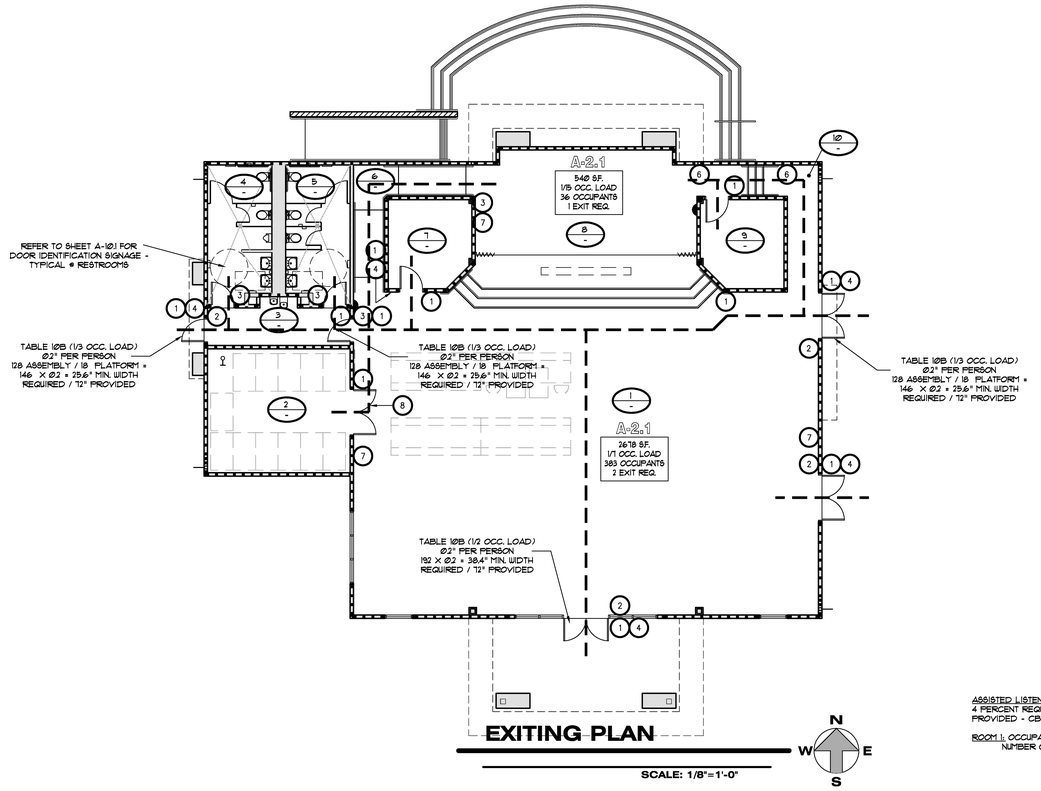

EXITING PLAN

SCALE: 1/8"=1'-0"

ASSISTED LISTENING DEVICES REQUIRED:
4 PERCENT REQUIRED, NO LESS THAN TWO PROVIDED - CBC 1604 B.2(1)

ROOM 1: OCCUPANCY LOAD = 383 PERSONS
NUMBER OF DEVICES = 15

SIGNAGE

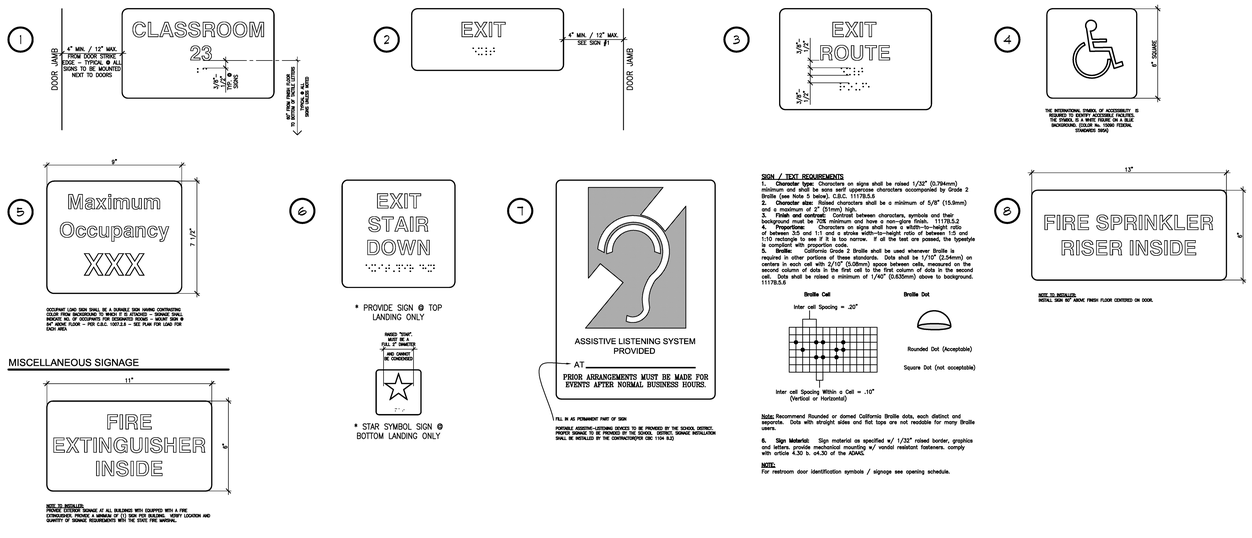

SIGN / TEXT REQUIREMENTS

1. **Character type:** Characters on signs shall be raised 1/32" (0.794mm) minimum and shall be sans serif uppercase characters accompanied by Grade 2 Braille (see Note 5 below), C.B.C. 11178.5.5
2. **Character size:** Raised characters shall be a minimum of 5/8" (15.9mm) and a maximum of 2" (51mm) high.
3. **Finish and contrast:** Contrast between characters, symbols and their background shall be at least 70 percent, C.B.C. 11178.5.3 and 11178.5.2
4. **Proportion:** Characters on signs shall have a width-to-height ratio of between 3:5 and 1:1 and a stroke width-to-height ratio of between 1:5 and 1:10 rectangle to see if it is too narrow. If all the text are passed, the typestyle is compliant with proportion code.
5. **Braille:** California Grade 2 Braille shall be used wherever Braille is required in other portions of these standards. Dots shall be 1/10" (2.54mm) on centers in each cell with 2/10" (5.08mm) space between cells, measured on the second column of dots in the first cell to the first column of dots in the second cell. Dots shall be raised a minimum of 1/40" (0.635mm) above to background. 11178.5.6

Braille Cell

Inter cell Spacing = .20"

Inter cell Spacing Within a Cell = .10" (Vertical or Horizontal)

Braille Dot

Rounded Dot (Acceptable)

Square Dot (not acceptable)

Note: Recommend Rounded or domed California Braille dots, each distinct and separate. Dots with straight sides and flat tops are not readable for many Braille users.

6. **Sign Material:** Sign material as specified w/ 1/32" raised border, graphics and letters. provide mechanical mounting w/ vandal resistant fasteners, comply with article 4.30 b. o4.30 of the ADAAG.

NOTE:
For restroom door identification symbols / signage see opening schedule.

MISCELLANEOUS SIGNAGE

NOTE TO INSTALLER:
PROVIDE EXTERIOR SIGNAGE AT ALL BUILDING WITH EQUIPPED WITH A FIRE EXTINGUISHER PROVIDE A MINIMUM OF (1) SIGN PER BUILDING. VERIFY LOCATION AND QUANTITY OF SIGNAGE REQUIREMENTS WITH THE CIVIL FIRE MARSHAL.

ROOM TITLES

ONE-HOUR SEPERATION

1. MULTI-PURPOSE
2. TABLE STORAGE
3. VESTIBULE
4. MEN'S TOILET
5. WOMEN'S TOILET
6. PLATFORM RAMP
7. STORAGE
8. PLATFORM
9. STORAGE
10. HALLWAY

KEY PLAN



LICENSED ARCHITECT
JAMES M. SHIVERS
C19098
RENEWAL 02/28/09
STATE OF CALIFORNIA

REVISION

P S W C GROUP
ARCHITECTS / PLANNERS
1867 BUSINESS CENTER DR., SUITE 3, SAN BERNARDINO, CA. 92408
909/890-2223 FAX. 909/890-2844

ROOSEVELT II
ELEMENTARY SCHOOL
SAN BERNARDINO CITY UNIFIED CITY SCHOOL DISTRICT

BUILDING "C"
EXITING AND SIGNAGE PLAN
1/8" = 1'-0"

JOB NO. FS20
DRAWN BY
DATE

A-C2.1

RE-BID #F09-02 ROOSEVELT II (HENRY) E.S. NEW CONSTRUCTION BID ISSUANCE SET 12/09/11