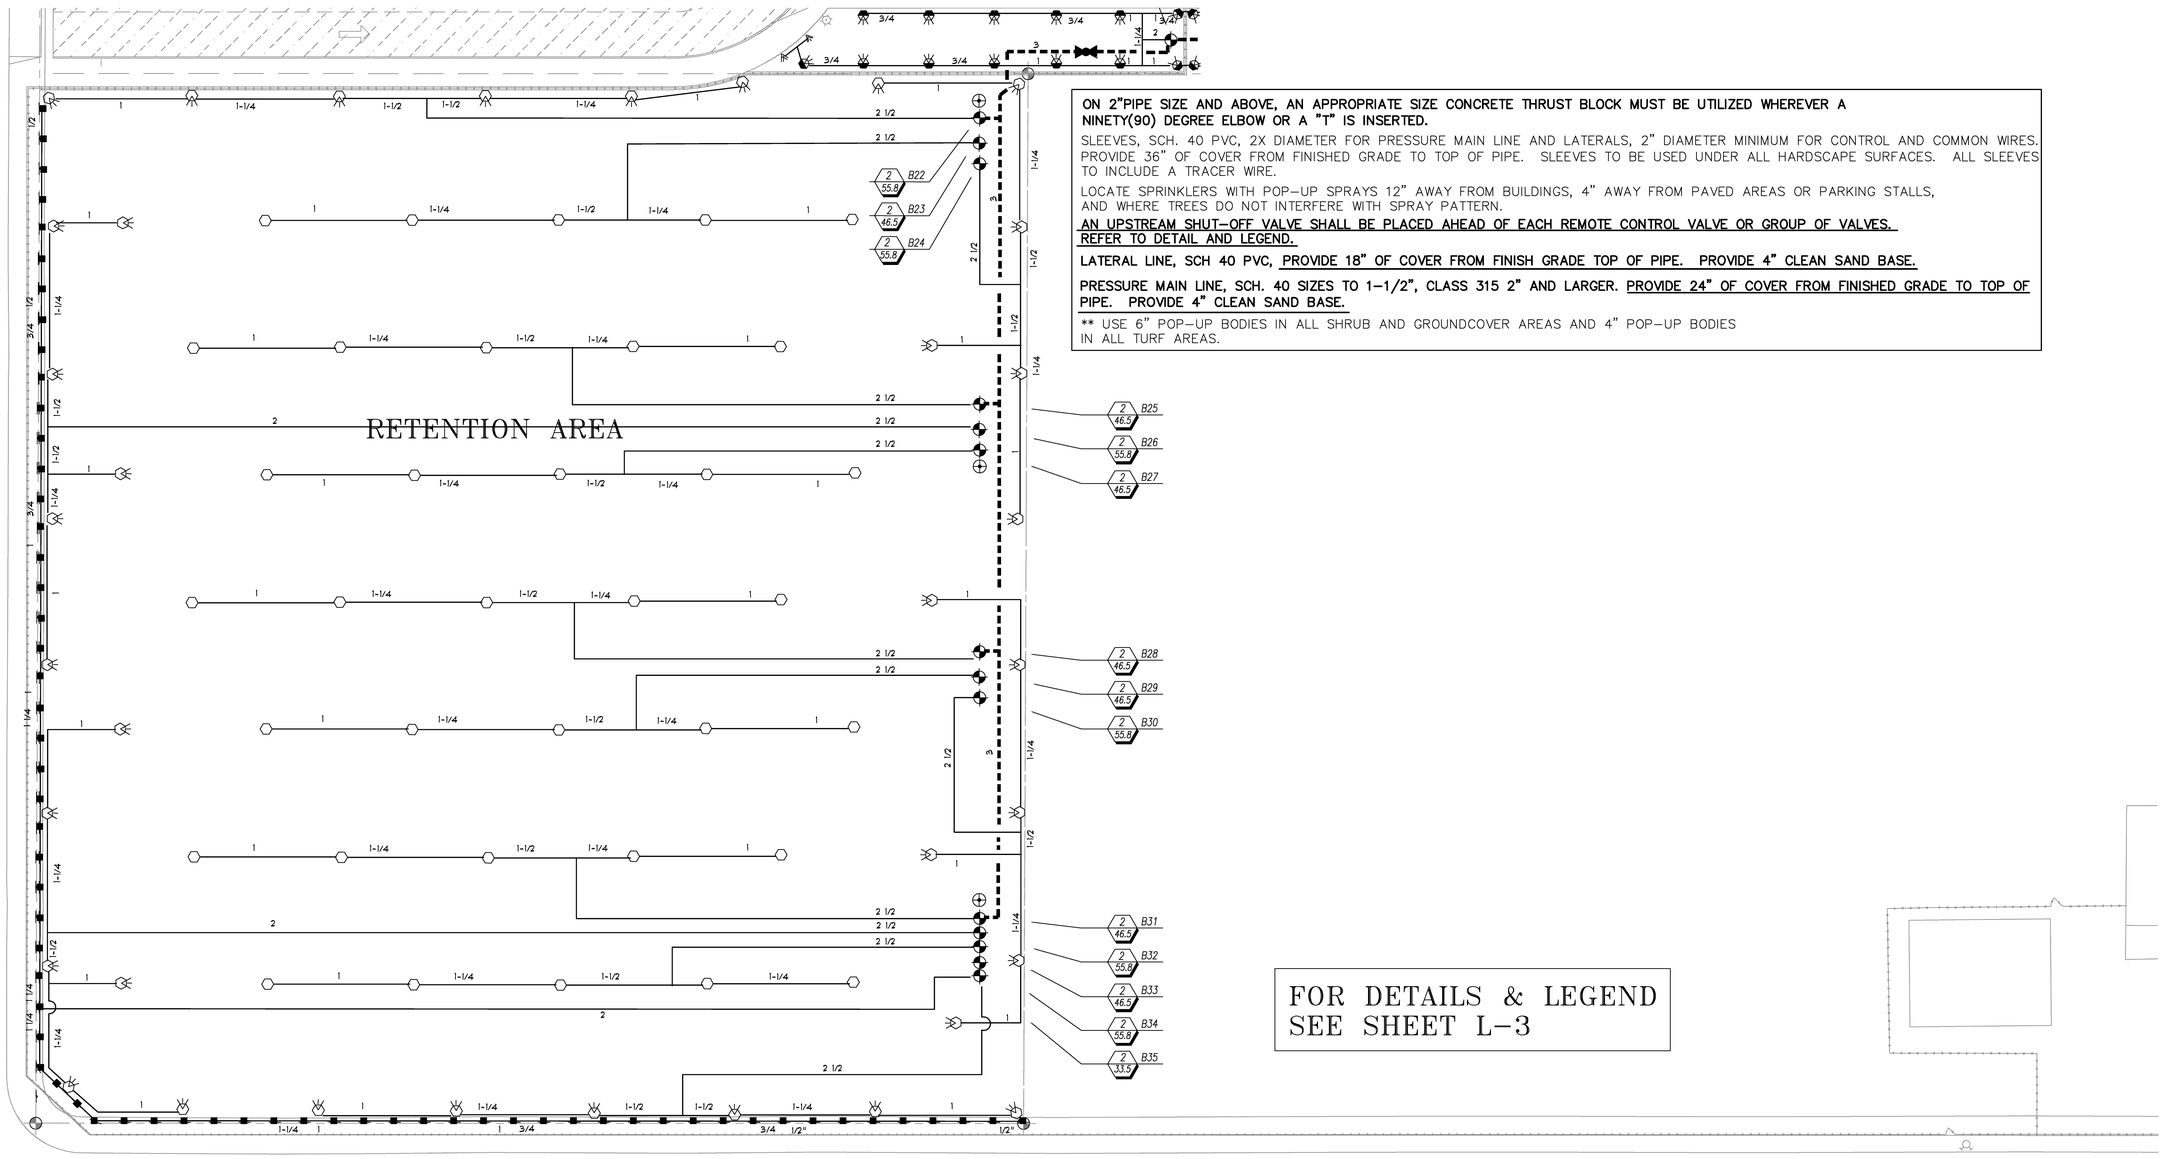

ON 2"PIPE SIZE AND ABOVE, AN APPROPRIATE SIZE CONCRETE THRUST BLOCK MUST BE UTILIZED WHEREVER A NINETY(90) DEGREE ELBOW OR A "T" IS INSERTED.

SLEEVES, SCH. 40 PVC, 2X DIAMETER FOR PRESSURE MAIN LINE AND LATERALS, 2" DIAMETER MINIMUM FOR CONTROL AND COMMON WIRES. PROVIDE 36" OF COVER FROM FINISHED GRADE TO TOP OF PIPE. SLEEVES TO BE USED UNDER ALL HARDSCAPE SURFACES. ALL SLEEVES TO INCLUDE A TRACER WIRE.

LOCATE SPRINKLERS WITH POP-UP SPRAYS 12" AWAY FROM BUILDINGS, 4" AWAY FROM PAVED AREAS OR PARKING STALLS, AND WHERE TREES DO NOT INTERFERE WITH SPRAY PATTERN.

AN UPSTREAM SHUT-OFF VALVE SHALL BE PLACED AHEAD OF EACH REMOTE CONTROL VALVE OR GROUP OF VALVES. REFER TO DETAIL AND LEGEND.

LATERAL LINE, SCH 40 PVC, PROVIDE 18" OF COVER FROM FINISH GRADE TOP OF PIPE. PROVIDE 4" CLEAN SAND BASE.

PRESSURE MAIN LINE, SCH. 40 SIZES TO 1-1/2", CLASS 315 2" AND LARGER. PROVIDE 24" OF COVER FROM FINISHED GRADE TO TOP OF PIPE. PROVIDE 4" CLEAN SAND BASE.

** USE 6" POP-UP BODIES IN ALL SHRUB AND GROUNDCOVER AREAS AND 4" POP-UP BODIES IN ALL TURF AREAS.

FOR DETAILS & LEGEND
SEE SHEET L-3

STUDIO
LANDSCAPE ARCHITECTURE

Robert Crandall
Landscape Architect
CA Lic. No. 3360

3272 Jessica Street
Newbury Park, CA 91320
(805)890-0441

LICENSED ARCHITECT
HAMID M. SHAHIDI
C19098
RENEWAL 02/28/13
STATE OF CALIFORNIA

CERTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
APPL. 04-107199
AC. ____ FLS ____ SS ____
DATE ____

REVISION
-
-
-
-

P S W C
ARCHITECTS / PLANNERS
1897 BUSINESS CENTER DR., SUITE 3, SAN BERNARDINO, CA. 92408
909/890-2233 FAX. 909/890-2844

ROOSEVELT II
ELEMENTARY SCHOOL
SAN BERNARDINO CITY UNIFIED SCHOOL DISTRICT
1281 W. 16TH STREET, SAN BERNARDINO, CA.

IRRIGATION PLAN

SCALE: 1"= 20'

JOB NO.	DRAWN BY	DATE
-	BC	12/9/11

L-2A

RE-BID #F09-02 ROOSEVELT II (HENRY) E.S. NEW CONSTRUCTION BID ISSUANCE SET 12/09/11