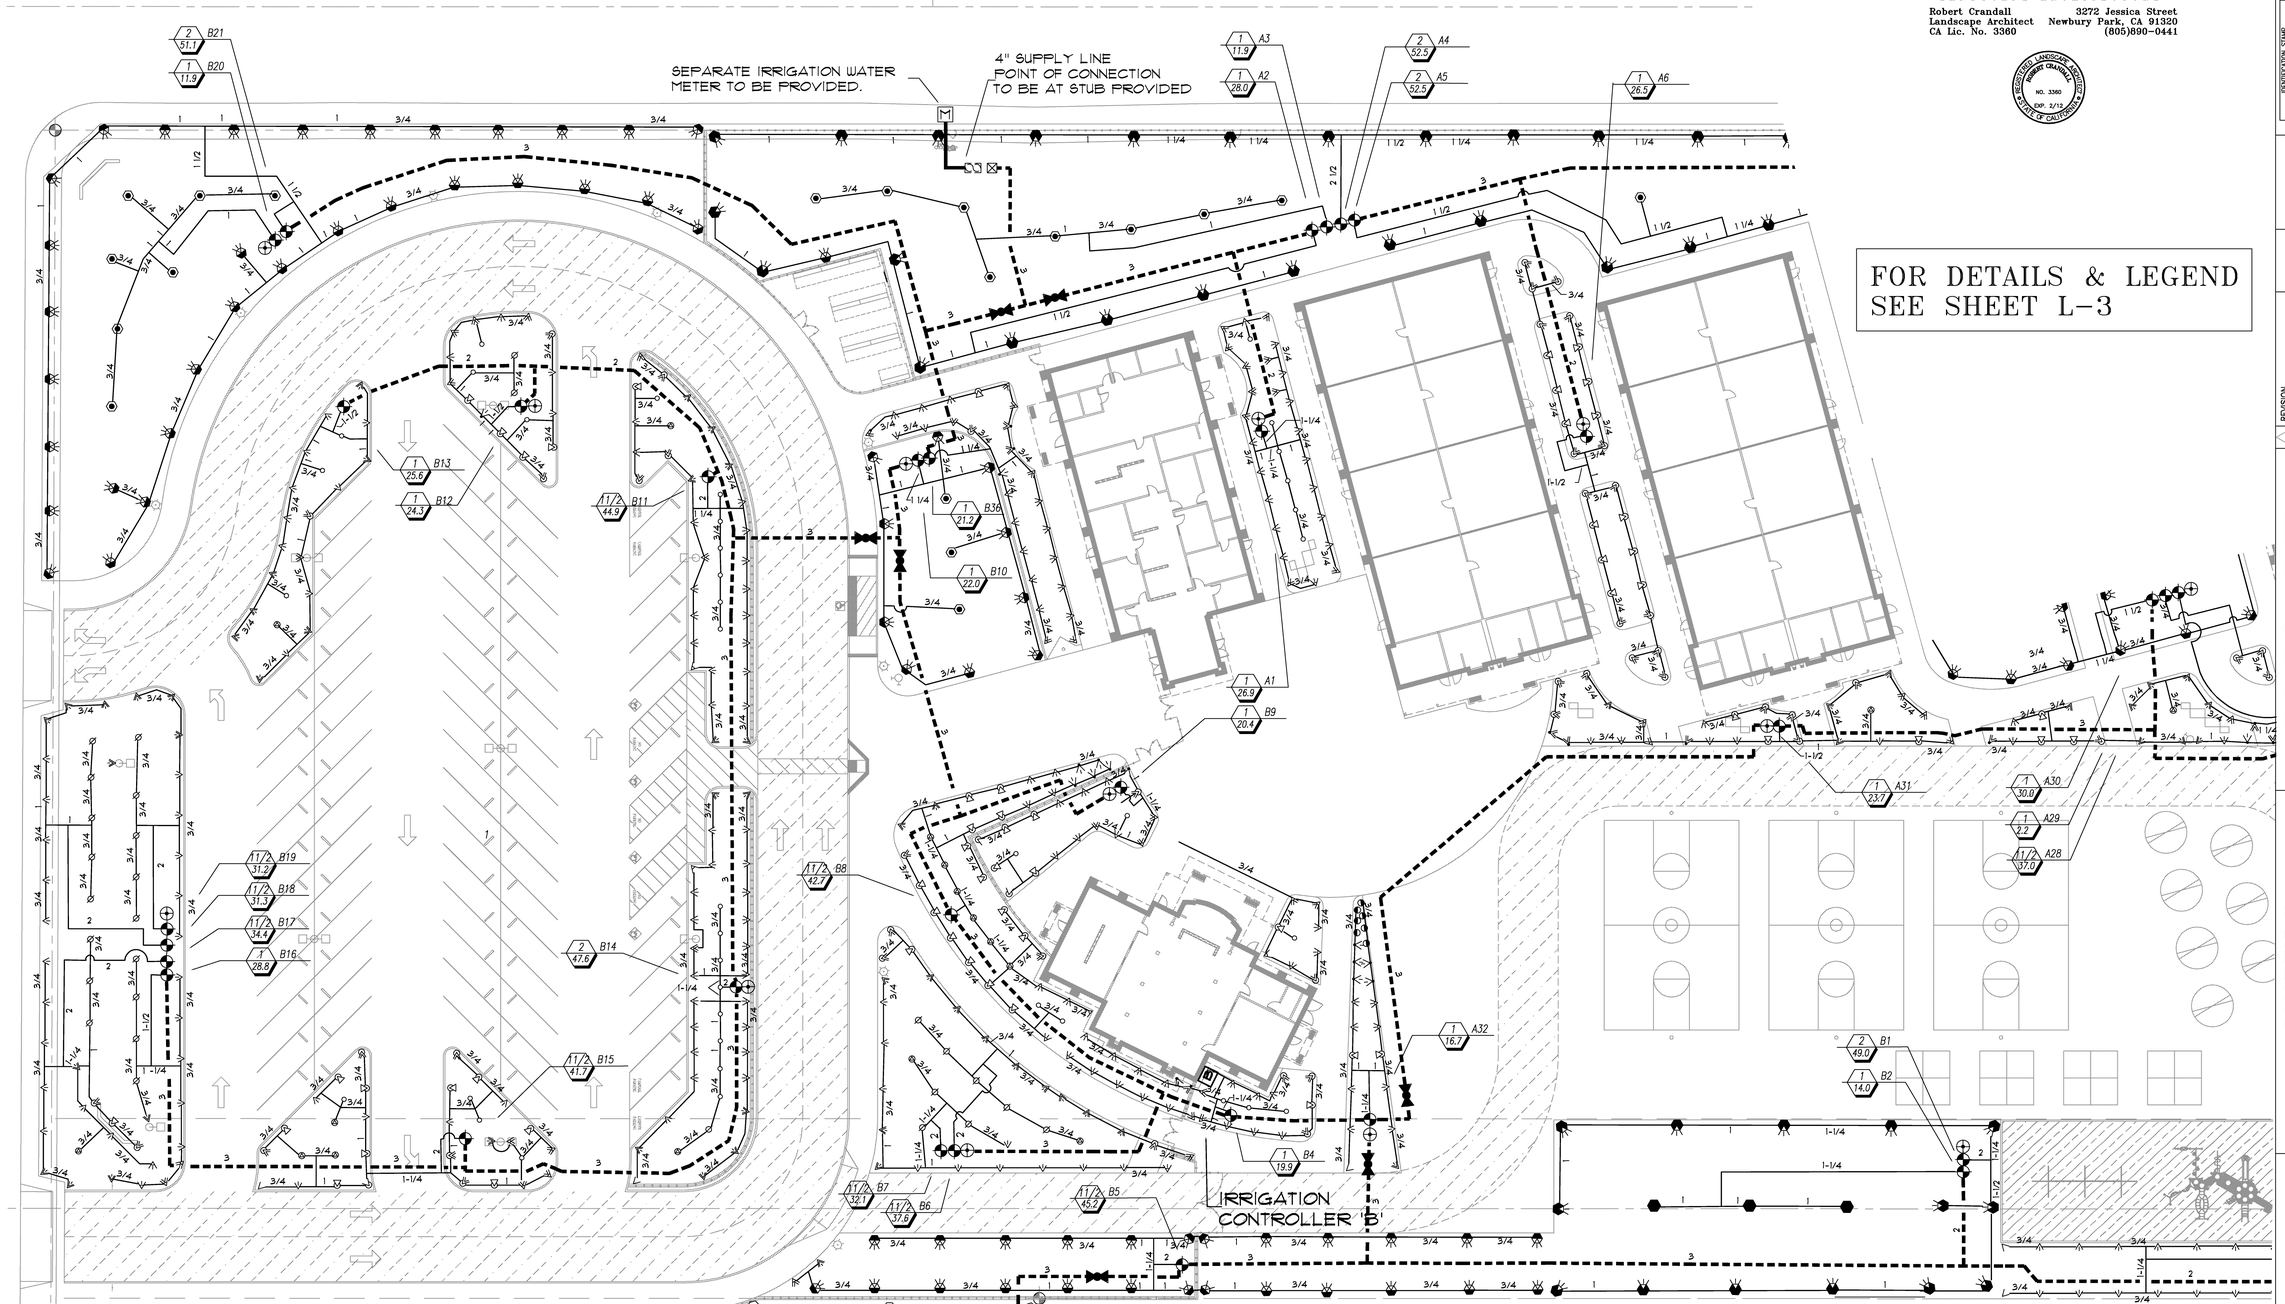

FOR DETAILS & LEGEND SEE SHEET L-3

ON 2"PIPE SIZE AND ABOVE, AN APPROPRIATE SIZE CONCRETE THRUST BLOCK MUST BE UTILIZED WHEREVER A NINETY(90) DEGREE ELBOW OR A "T" IS INSERTED.

SLEEVES, SCH. 40 PVC, 2X DIAMETER FOR PRESSURE MAIN LINE AND LATERALS, 2" DIAMETER MINIMUM FOR CONTROL AND COMMON WIRES. PROVIDE 36" OF COVER FROM FINISHED GRADE TO TOP OF PIPE. SLEEVES TO BE USED UNDER ALL HARDSCAPE SURFACES. ALL SLEEVES TO INCLUDE A TRACER WIRE.

LOCATE SPRINKLERS WITH POP-UP SPRAYS 12" AWAY FROM BUILDINGS, 4" AWAY FROM PAVED AREAS OR PARKING STALLS, AND WHERE TREES DO NOT INTERFERE WITH SPRAY PATTERN.

AN UPSTREAM SHUT-OFF VALVE SHALL BE PLACED AHEAD OF EACH REMOTE CONTROL VALVE OR GROUP OF VALVES. REFER TO DETAIL AND LEGEND.

LATERAL LINE, SCH 40 PVC, PROVIDE 18" OF COVER FROM FINISH GRADE TOP OF PIPE. PROVIDE 4" CLEAN SAND BASE.

PRESSURE MAIN LINE, SCH. 40 SIZES TO 1-1/2", CLASS 315 2" AND LARGER. PROVIDE 24" OF COVER FROM FINISHED GRADE TO TOP OF PIPE. PROVIDE 4" CLEAN SAND BASE.

** USE 6" POP-UP BODIES IN ALL SHRUB AND GROUNDCOVER AREAS AND 4" POP-UP BODIES

STUDIO
LANDSCAPE ARCHITECTURE
Robert Crandall
Landscape Architect
CA Lic. No. 3360
3272 Jessica Street
Newbury Park, CA 91320
(805)690-0441

LICENSED ARCHITECT JAMES M. STANTON C19098 RENEWAL 02/28/13 STATE OF CALIFORNIA

IDENTIFICATION STAMP DIV. OF STATE ARCHITECT OFFICE OF REGULATION SERVICES APPL 04-107199 AC. ____ FLS. ____ SS. ____ DATE: ____

REVISION

P S W C GROUP
ARCHITECTS / PLANNERS
1887 BUSINESS CENTER DR., SUITE 3, SAN BERNARDINO, CA. 92408
909/890-2233 FAX. 909/890-2644

ROOSEVELT II ELEMENTARY SCHOOL
SAN BERNARDINO CITY UNIFIED SCHOOL DISTRICT
1261 W. 16TH STREET, SAN BERNARDINO, CA.

IRRIGATION PLAN

SCALE: 1"= 20'

JOB NO.
DRAWN BY BC
DATE

L-1

RE-BID #F09-02 ROOSEVELT II (HENRY) E.S. NEW CONSTRUCTION BID ISSUANCE SET 12/09/11